


LEGEND	
---	FACTORY LOW VOLTAGE WIRING
---	FACTORY LINE VOLTAGE WIRING
---	FIELD LOW VOLTAGE WIRING
---	FIELD LINE VOLTAGE WIRING
---	PRINTED CIRCUIT TRACE
---	OPTIONAL WIRING
---	OPTIONAL BLOCK
---	CAPACITOR
---	CIRCUIT BREAKER
---	CONDENSATE PAN
---	GROUND
---	HIGH PRESSURE SWITCH
---	LED
---	LOW PRESSURE SWITCH
---	MATE-IN-LOCK
---	MULTI SPLICE CONNECTOR
---	OPTIONAL
---	OVERLOAD
---	RELAY CONTACTS - N.C.
---	RELAY CONTACTS - N.O.
---	RELAY / CONTACTOR COIL
---	SOLENOID COIL
---	SPLICE CAP
---	TEMPERATURE SWITCH
---	THERMISTOR
---	WIRE NUT

AL	ALARM RELAY CONTACTS
BM	BLOWER MOTOR
BMC	BLOWER MOTOR CAPACITOR
BR	BLOWER RELAY
CAP	CAPACITOR
CB	CIRCUIT BREAKER
CC	COMPRESSOR CONTACTOR
CO	CONDENSATE OVERFLOW SENSOR
CR	COMPRESSOR RELAY
CTB	COMMON TERMINAL BLOCK
CS	CURRENT SENSOR
DHW	DOMESTIC HOT WATER
DM	DAMPER MOTOR
DTS	DISCHARGE TEMPERATURE SWITCH
ES	END SWITCH
EWT	ENTERING WATER TEMP SENSOR
FPI	SENSOR, LOW TEMP PROTECTION, WATER COIL
FP2	SENSOR, LOW TEMP PROTECTION, AIR COIL
FSS	FAN SPEED SWITCH
HP	HIGH PRESSURE SWITCH
HPWS	HIGH PRESSURE WATER SWITCH
HR	HEATING RELAY
JW	JUMPER WIRE
LAT	LEAVING AIR TEMPERATURE
LOC	LOSS OF CHARGE PRESSURE SWITCH
LOR	LOCK OUT RELAY
LWTS	LEAVING WATER TEMP SENSOR
MOD	MODULATING WATER VALVE
MS	MANUAL STARTER
MSC	MULTI SPLICE CONNECTOR
MWV	MOTORIZED WATER VALVE
PB	POWER TERMINAL BLOCK
PDB	POWER DISTRIBUTION BLOCK
POT	POTENTIOMETER
PI	FIELD WIRING TERMINAL BLOCK
PR	PUMP RELAY
RAS	RETURN AIR SENSOR
RVS	REVERSING VALVE SOLENOID
SAS	SUPPLY AIR SENSOR
SAC	START ASSIST CAPACITOR
TB	TERMINAL BLOCK
TRANS	TRANSFORMER
TS	TERMINAL STRIP
UMT	UNIT MOUNTED THERMOSTAT

- NOTES:
1. COMPRESSOR AND BLOWER MOTOR THERMALLY PROTECTED INTERNALLY.
 2. ALL WIRING TO THE UNIT MUST COMPLY WITH NEC AND LOCAL CODES.
 3. 208/230V TRANSFORMER SHALL BE CLASS 2 OR EQUIVALENT.
 4. 230V OPERATION, DISCONNECT RED LEAD AT LI AND ATTACH ORG LEAD TO LI.
 5. INSULATE OPEN END OF RED LEAD.
 6. LTI PROVIDES LOW TEMPERATURE PROTECTION FOR WATER. WHEN USING ANTI-FREEZE SOLUTIONS, CUT JW3 JUMPER.
 7. TYPICAL HEAT PUMP THERMOSTAT WIRING SHOWN. REFER TO THERMOSTAT IOM FOR WIRING TO THE UNIT. T-STAT WIRING MUST BE "CLASS 1" AND VOLTAGE RATING EQUAL TO OR GREATER THAN UNIT SUPPLY VOLTAGE.
 8. 24V ALARM SIGNAL SHOWN. FOR DRY ALARM CONTACT BETWEEN AL1 & AL2. CUT JW1 FOR CXM/DXM GEN2 OR JW4 DXM.

7. TRANSFORMER SECONDARY GROUND VIA CXM/DXM BOARD STANDOFFS AND SCREWS TO CONTROL BOX.

ASW1. ASW SENSORS ARE NOT REQUIRED ON WATER-WATER APPLICATION. ASW06-ASW08 (WATER-AIR ONLY) MOVE JUMPER TO LSTAT. ASW13-ASW15 MOVE JUMPER TO RNET. ECM1. FOR ECM BLOWER MOTOR AIR FLOW ADJUSTMENT AND DIAGNOSTIC INFORMATION REFER TO I.O.M. HWG3. AQUA STAT IS SUPPLIED WITH UNIT AND MUST BE WIRED IN SERIES WITH THE HOT LEG TO THE PUMP. AQUA STAT IS RATED FOR VOLTAGE UP TO 277V. LONI. REFER TO LON, OR TSTAT INSTALLATION, APPLICATION, AND OPERATION MANUAL FOR CONTROL WIRING TO THE UNIT. MPC2. REFER TO MPC INSTALLATION APPLICATION, AND OPERATION MANUAL FOR CONTROL WIRING TO THE UNIT. MWV1. WIRE FROM "Y1" ON TSTAT/MPC/LON TO "Y" ON CONTROL BOARD WHEN MWV IS NOT USED. PMP1. FOR VARIABLE SPEED PUMP CONTROL AND DIAGNOSTIC INFORMATION REFER TO UNIT IOM. PMP2. FOR VARIABLE SPEED PUMP OPTION, PLACE JUMPER ON PWM PINS.

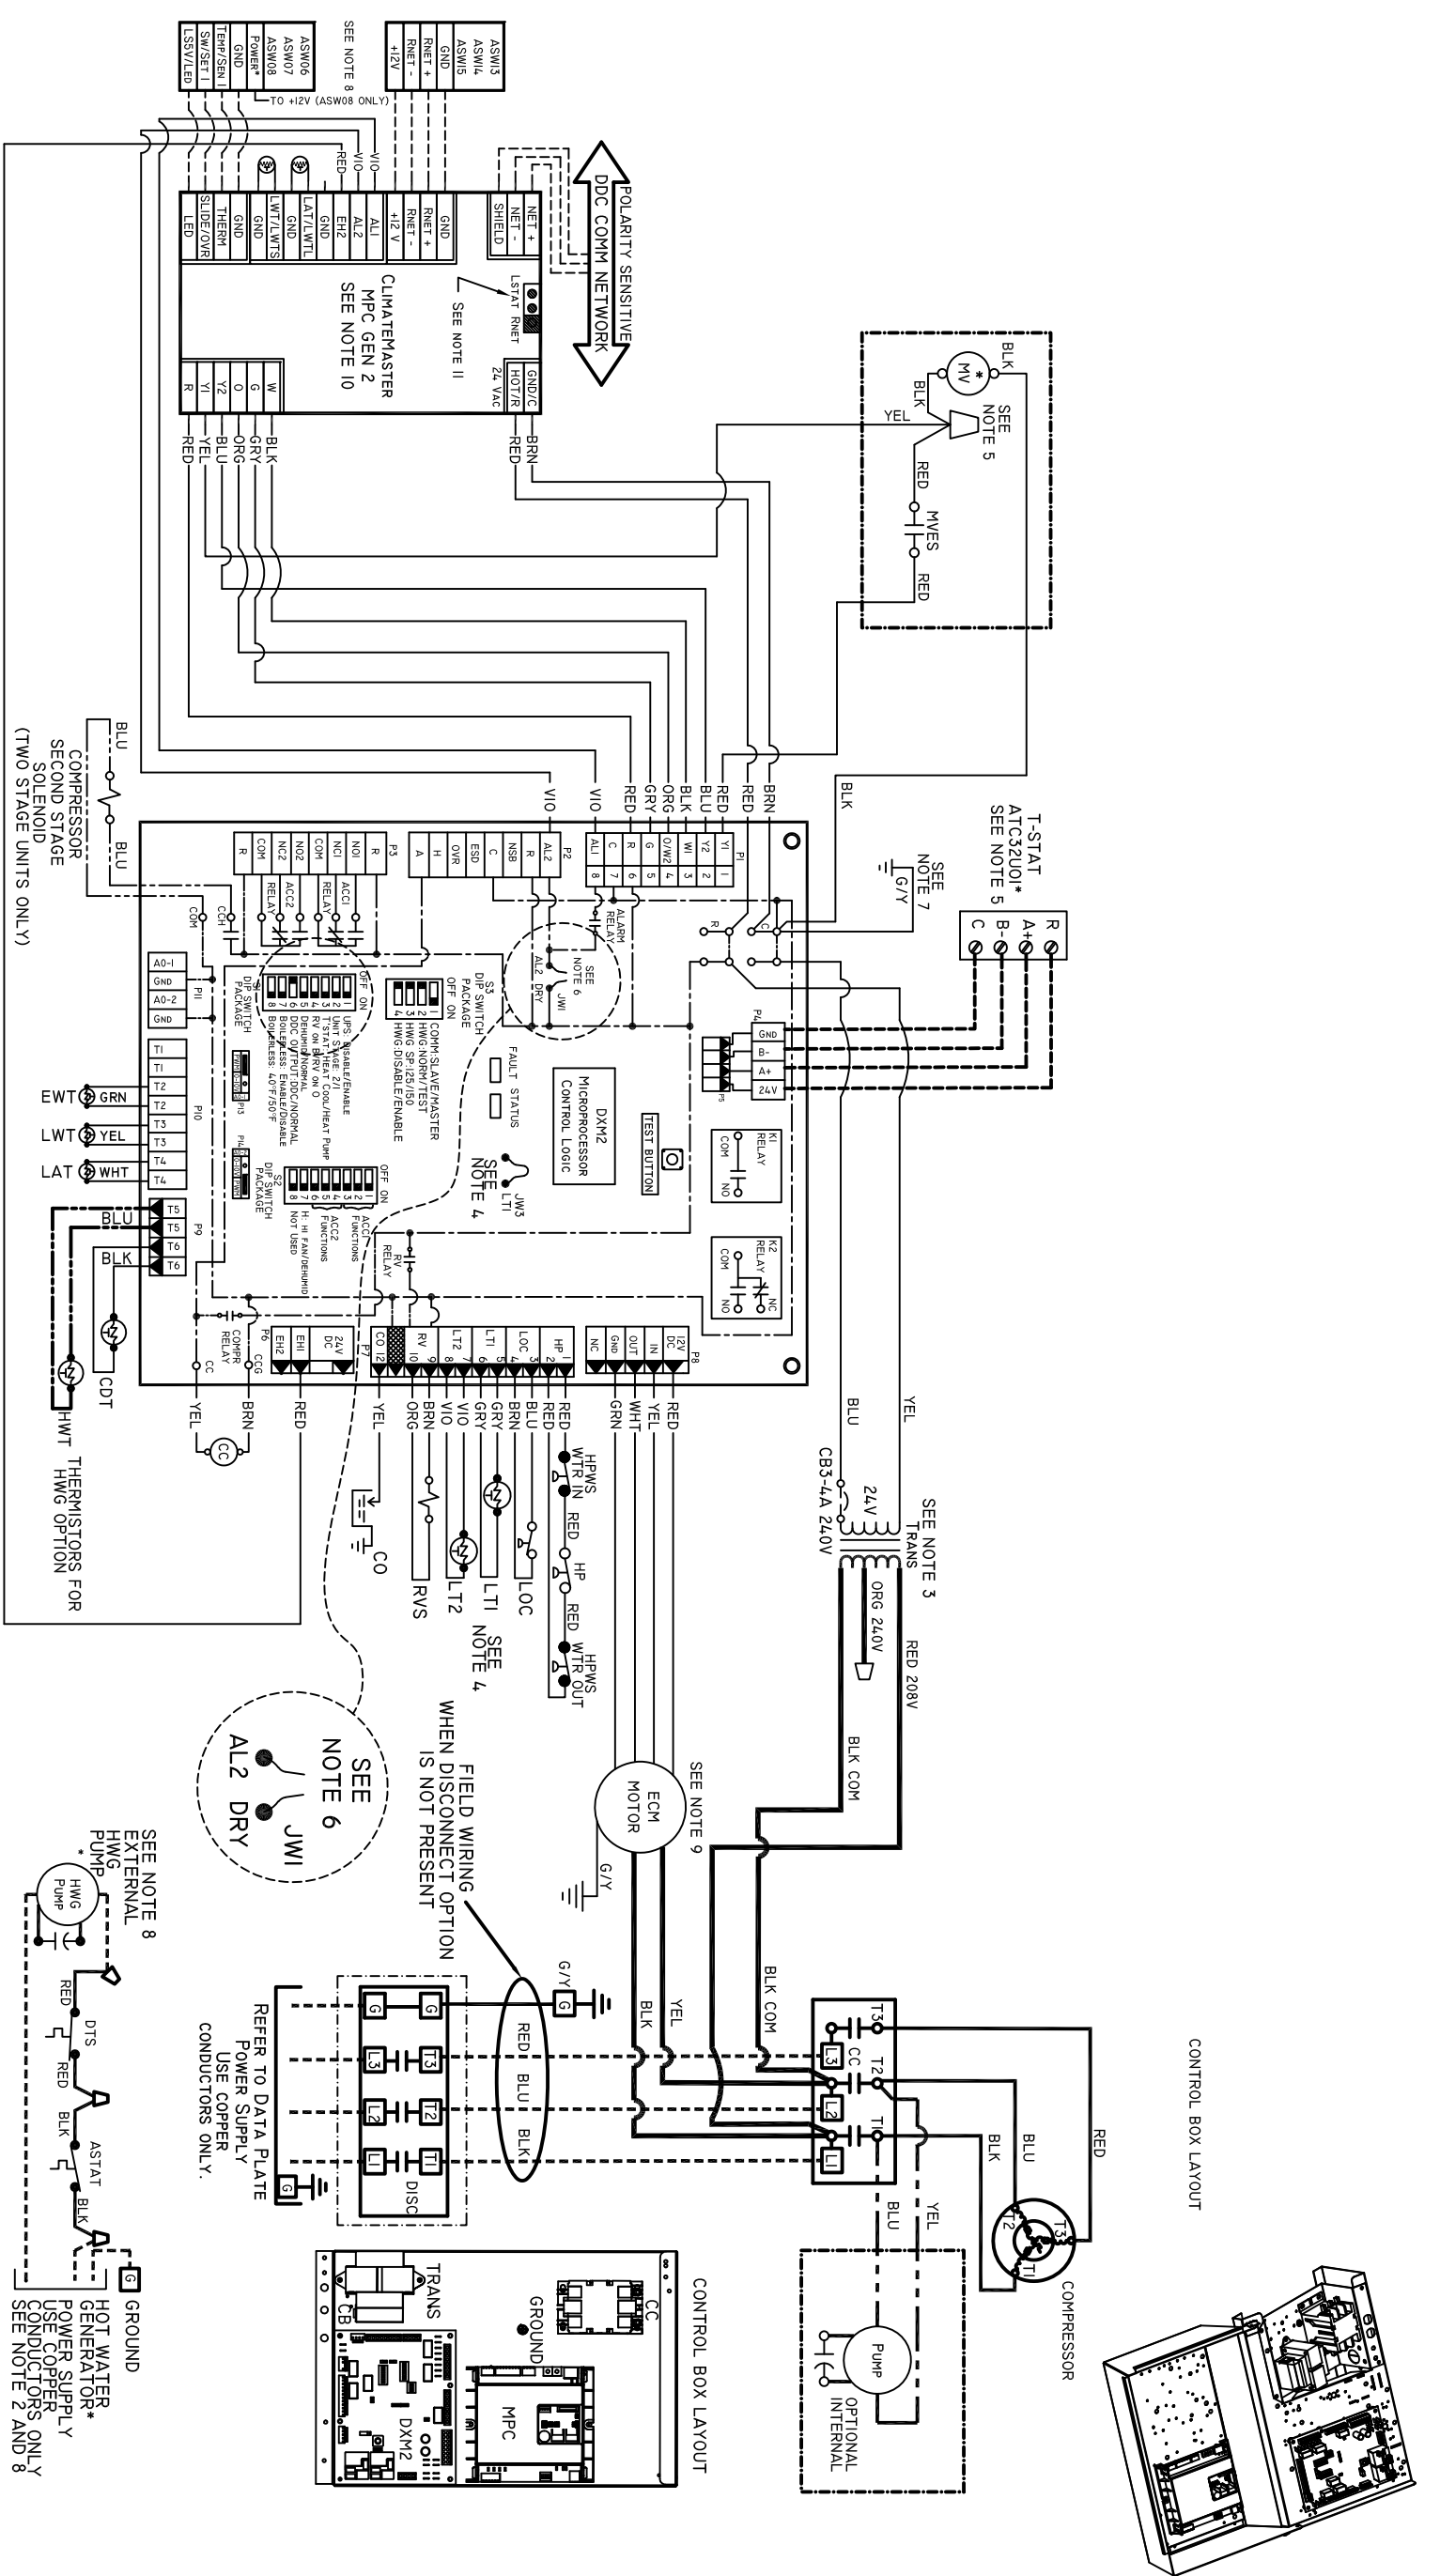

CONTROL BOX LAYOUT

CONTROL BOX LAYOUT

REFER TO DATA PLATE POWER SUPPLY CONDUCTORS ONLY.

NOTE 6
AL2 DRY
JW1

FIELD WIRING WHEN DISCONNECT OPTION IS NOT PRESENT

