

TITLE:

LV 084-300 AUX W/D LON + DXM

PCN:

10-0010

DATE:

01/06/10





DRAWING NO:

96B0149N02


REV:

-

LON+DXM OPTION

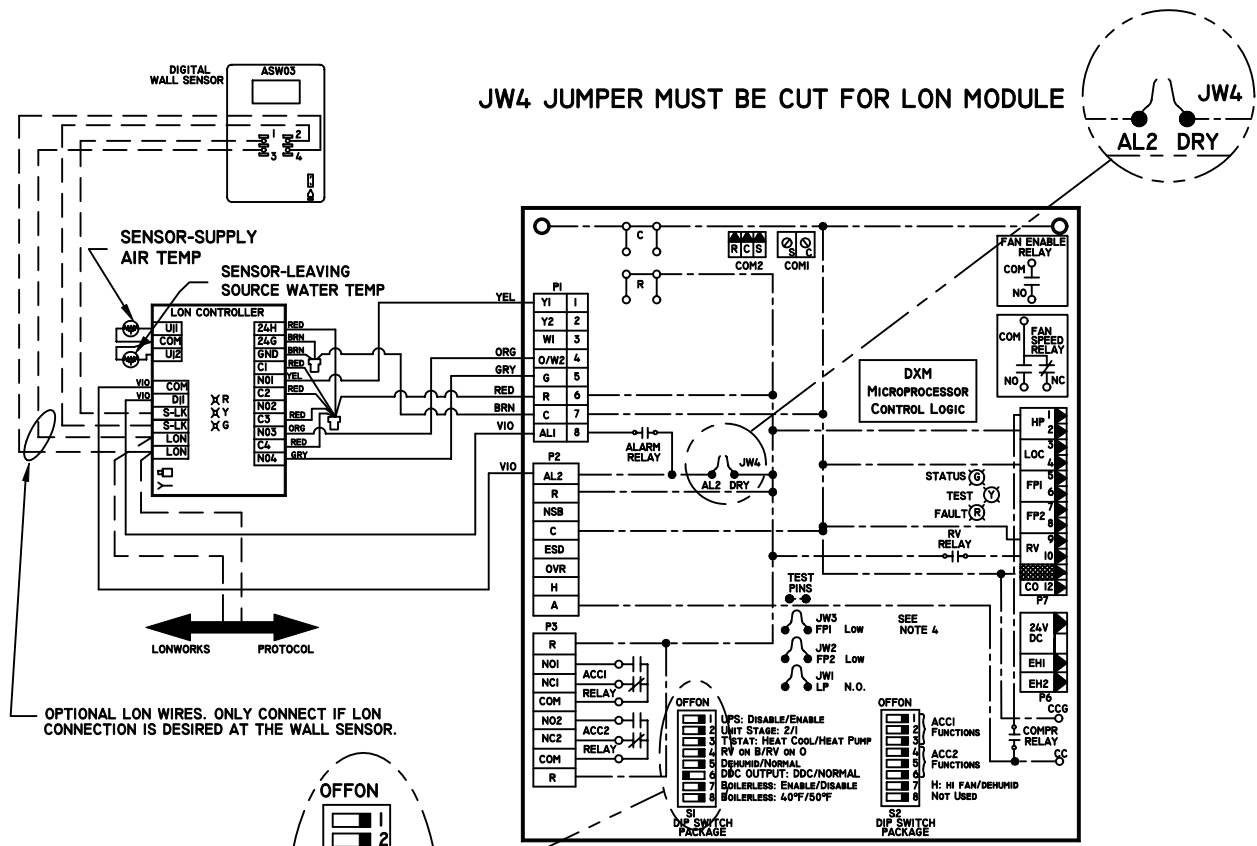



REFER TO LONWORKS INSTALLATION, APPLICATION, AND OPERATION MANUAL FOR CONTROL WIRING TO THE UNIT. LOW VOLTAGE WIRING MUST BE "CLASS I" AND VOLTAGE RATED EQUAL OR GREATER THAN UNIT SUPPLY VOLTAGE.

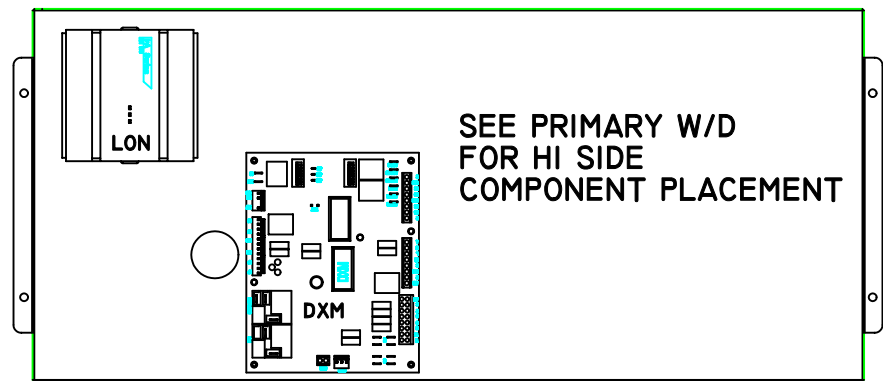


CONTROL BOX LAYOUT LOW SIDE

SEE PRIMARY W/D FOR HI SIDE COMPONENT PLACEMENT

LON+DXM (2X) OPTION

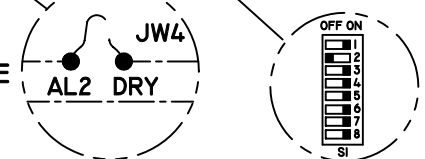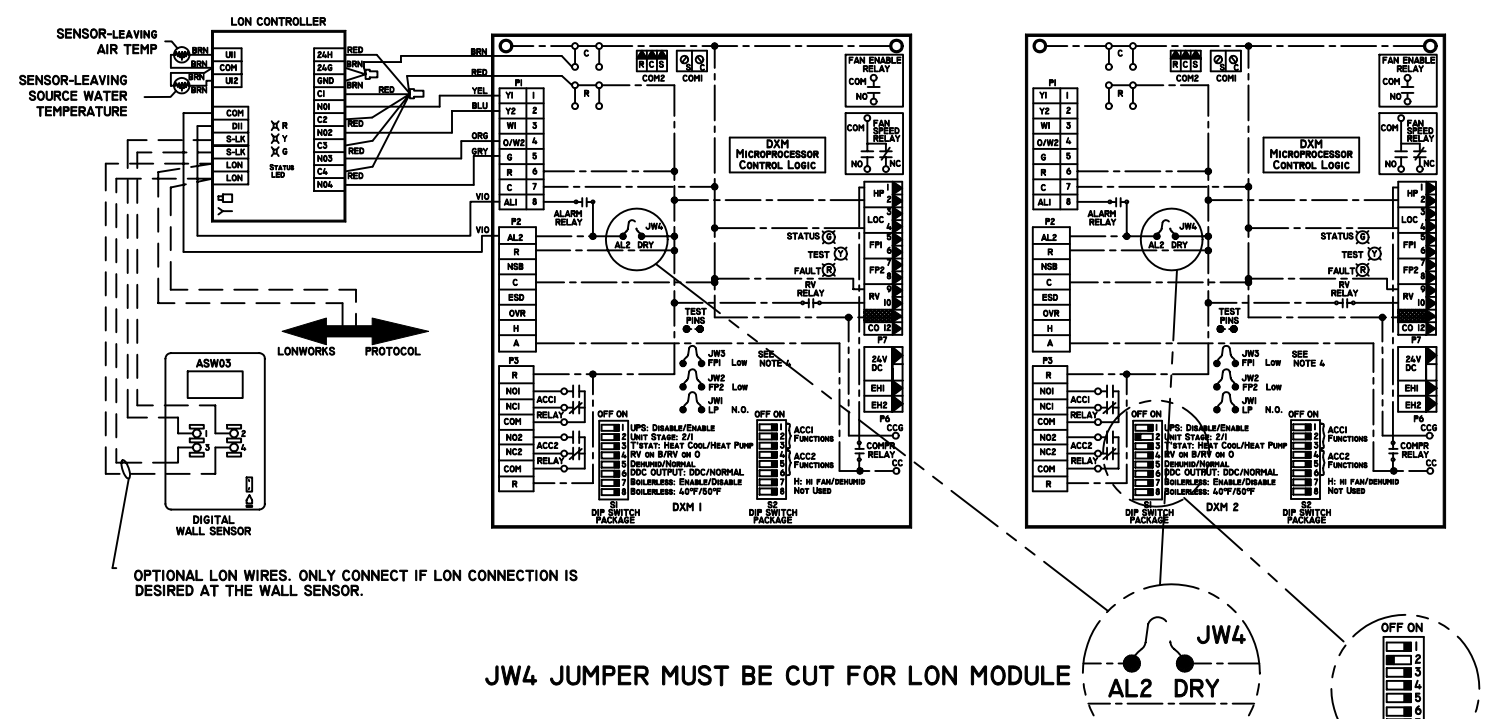

REFER TO LONWORKS INSTALLATION, APPLICATION, AND OPERATION MANUAL FOR CONTROL WIRING TO THE UNIT. LOW VOLTAGE WIRING MUST BE "CLASS I" AND VOLTAGE RATED EQUAL OR GREATER THAN UNIT SUPPLY VOLTAGE.

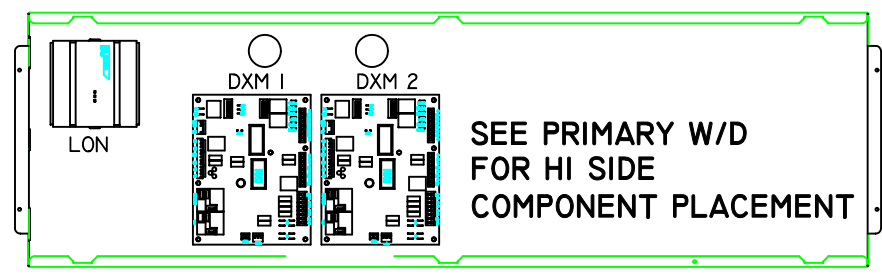

CONTROL BOX LAYOUT LOW SIDE

SEE PRIMARY W/D FOR HI SIDE COMPONENT PLACEMENT