


803 Series

Standard Operating Range
55°F to 95°F Entering Water Temp.


Size 009

Dimensions

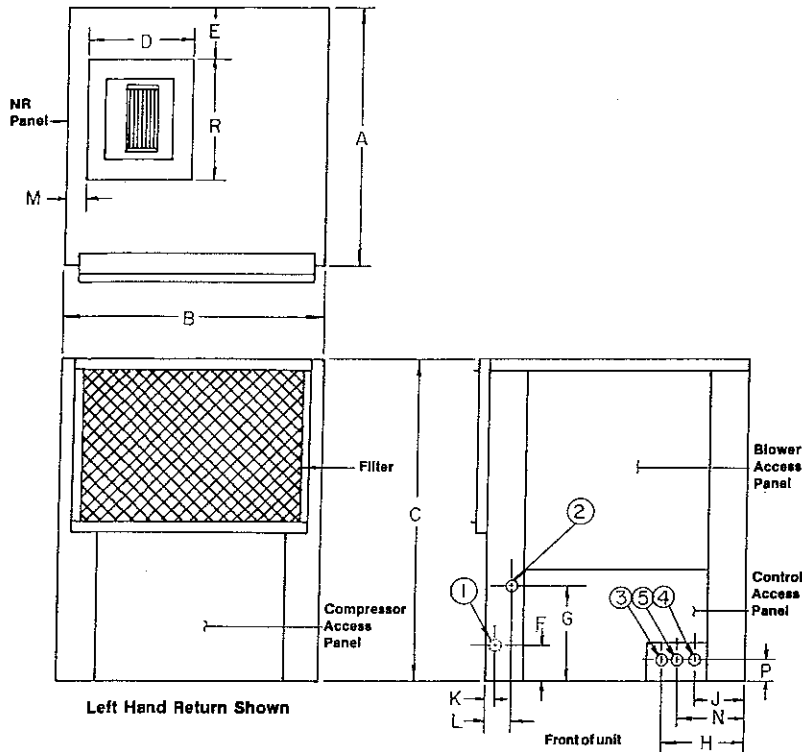

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R
IN.	19 ¹ / ₈	19 ¹ / ₈	23 ¹ / ₈	7	3 ¹ / ₈	3 ⁷ / ₈	9 ¹ / ₈	7 ¹ / ₂	3	1 ³ / ₈	1 ⁷ / ₈	1 ¹ / ₈	5 ¹ / ₄	2 ¹ / ₈	9 ⁷ / ₈
CM.	49	49	61	18	10	8	25	19	8	4	4	4	13	5	25

FILTER SIZE	10" x 16" x 1" 25 x 41 x 2.5 CM	SHIPPING WGT.	118 lbs. 54 Kg
-------------	------------------------------------	---------------	-------------------

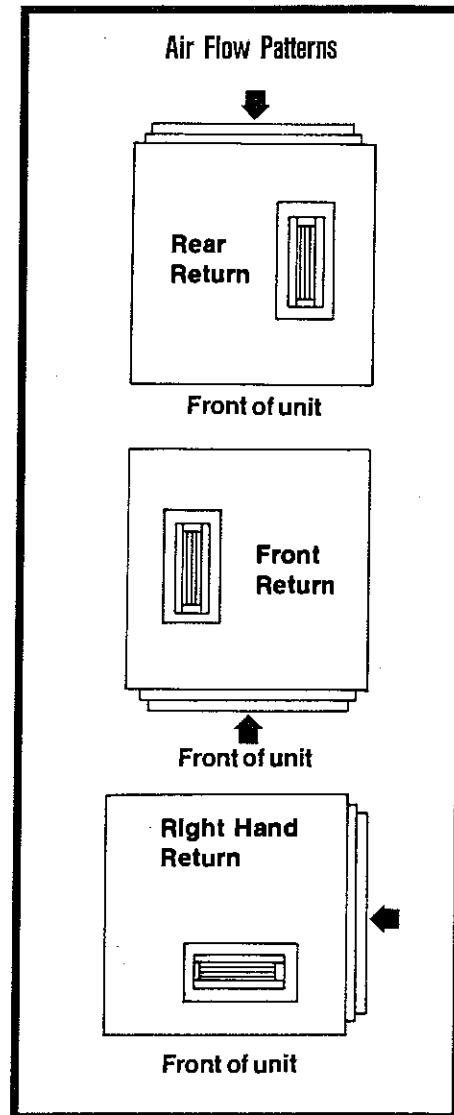

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	0.5	3.3	20.0	4.6	15
265	1	0.5	2.8	16.0	4.0	15

ClimateMaster®

FORMERLY CHP CORP AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 9100 Btuh, Power Input: 825 Watts, E.E.R.: 11.0 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 350 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	7298	—	—	—	—	—	9938	776
61	7899	9955	—	—	—	—	10629	800
64	8499	8536	7398	8499	—	—	11320	825
67	9100	7107	6400	7802	9100	—	11916	825
70	9700	5833	7817	6899	8198	8416	12512	825
73	10201	—	6397	5900	7302	7744	13096	850

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	275	290	320	330	350	360
Total Capacity	.970	.976	.988	.992	1.00	1.004
Sensible Capacity	.934	.947	.973	.982	1.00	1.009
Heat of Rejection	.942	.953	.977	.984	1.00	1.008
Power Input	.966	.973	.986	.991	1.00	1.005

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

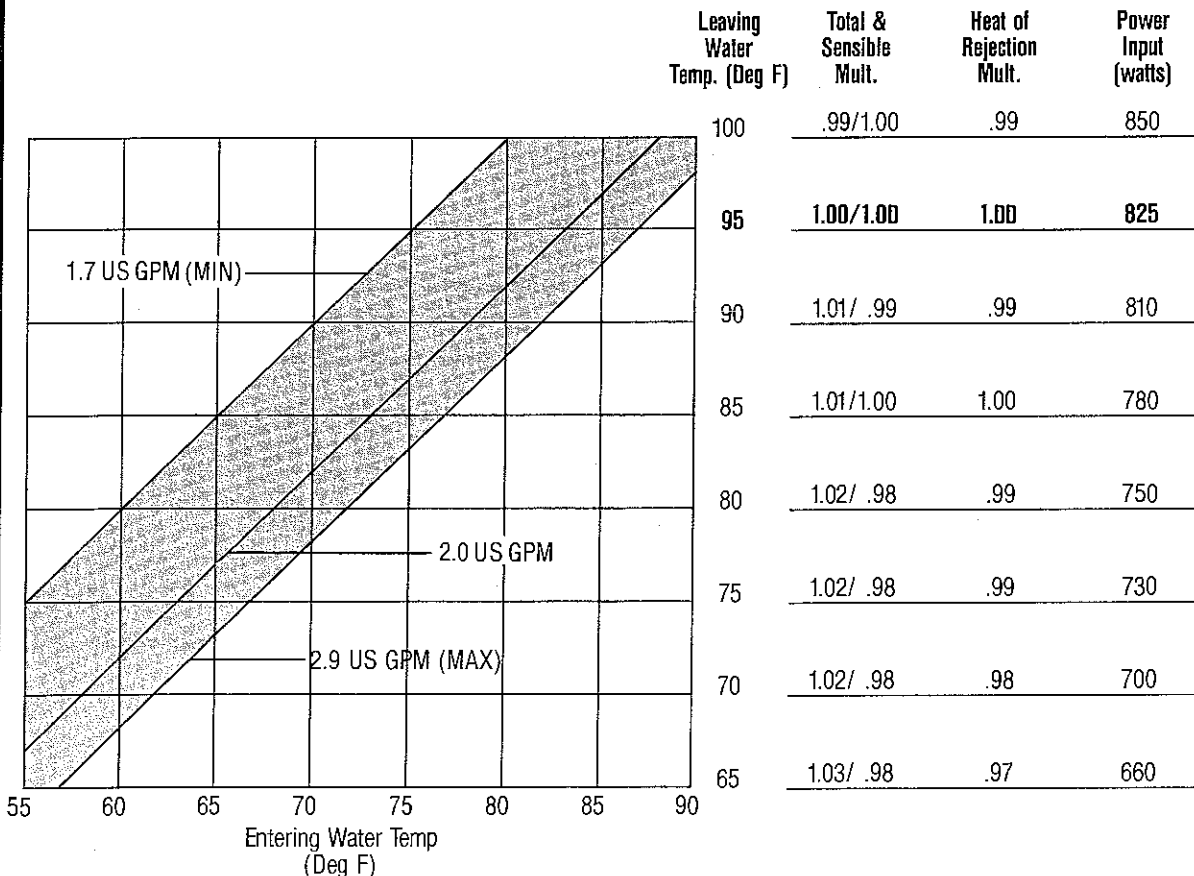

Heating Performance

Heating Capacity: 10800 Btuh, Power Input: 850 Watts, C.O.P.: 3.7 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.070	1.046	1.019	1.00	.981	.963	.948
Heat of Absorption	1.100	1.074	1.036	1.00	.964	.939	.914
Power Input	.982	.971	.971	1.00	1.029	1.029	1.030

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	275	290	320	330	350	360
Heating Capacity	.970	.976	.988	.992	1.00	1.004
Heat of Absorption	.950	.960	.980	.987	1.00	1.007
Power Input	1.017	1.014	1.007	1.005	1.00	.998

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

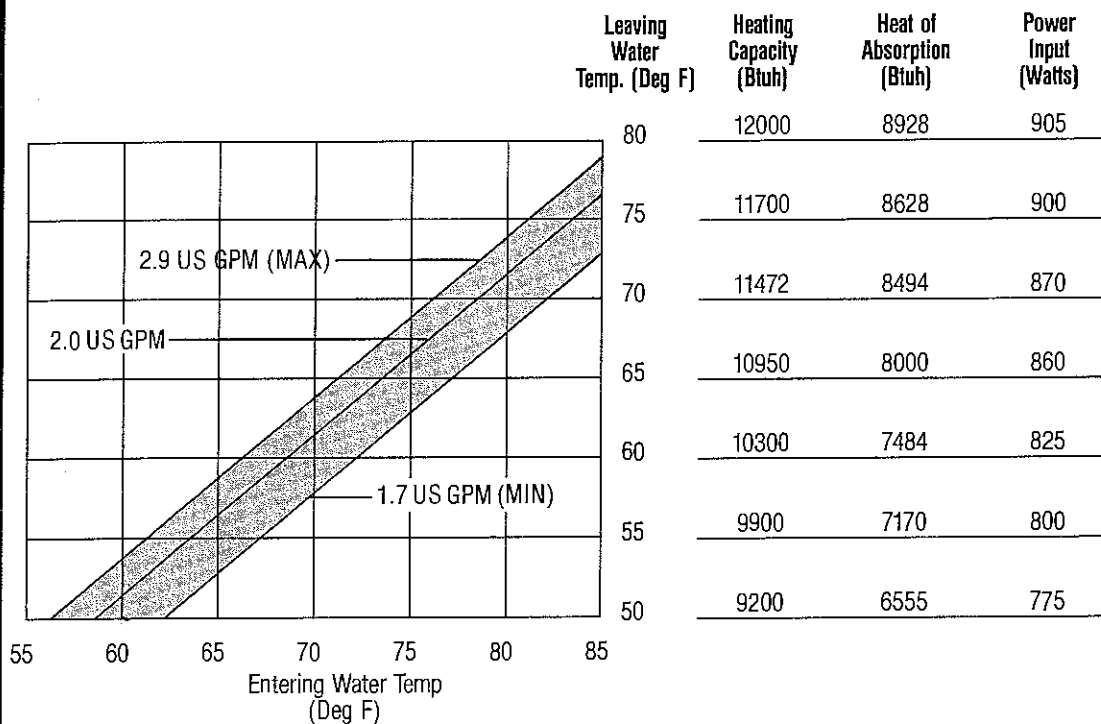


Water Pressure Drop:

A.R.I. Typical Application Flow Rates:

	3.2	2.2	2.5	2.7	3.5	3.8
Rate, (GPM/12 MBTU)						
Water Flow, (US GPM)	2.4	1.7	1.9	2.0	2.6	2.9
Pressure Drop, (Ft.) (H ₂ O)	4.01	1.52	2.63	4.00	4.71	5.6
	(min.)			(Recommended)		(max.)

Wiring Diagram

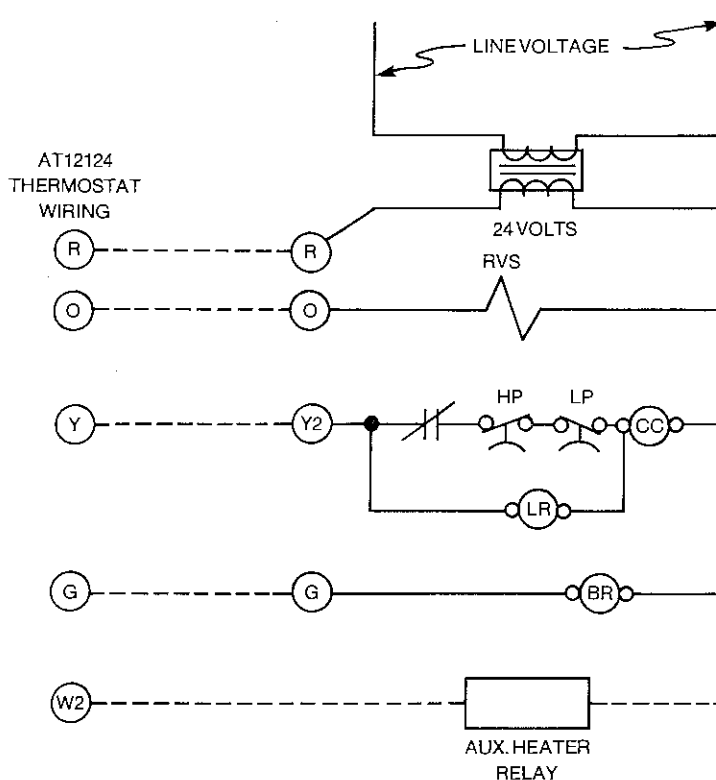

NOTES:

--- Field Wiring
Aux. Heater Relay is a field installed option.

ACO = AUTOMATIC CHANGEOVER RELAY
AS = ANTI-SHORT CYCLE RELAY
BM = BLOWER MOTOR
BMC = BLOWER MOTOR CAPACITOR
BR = BLOWER RELAY
CC = COMPRESSOR CONTACTOR
CCH = CRANKCASE HEATER
COMP = COMPRESSOR
CPC = COMPRESSOR CAPACITOR
CR = CONTROL RELAY

DL = DEMAND LIMIT RELAY
FS = FREEZE STAT
HL = HIGH LEVEL CONDENSATE SWITCH
HP = HIGH PRESSURE SWITCH
HT = HIGH TEMPERATURE SWITCH
LP = LOW PRESSURE SWITCH
LR = LOCKOUT RELAY
OL = OVERLOAD
PR = PROGRAM RELAY
RS = RANDOM START RELAY

RVR = REVERSING VALVE RELAY
RVS = REVERSING VALVE SOLENOID
SD = SHUTDOWN RELAY
SLR = SPECIAL LOCKOUT RELAY
SSM = SAFETY SHUTDOWN MODULE
TB = 24-VOLT TERMINAL BLOCK
TD = TIME DELAY RELAY
TR = TIMER RELAY
TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	356	332	301	254							240
Lo	330	306	280	250							
Med	300	280	260	240							

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

803 Series

Standard Operating Range
55°F to 95°F Entering Water Temp.

Size 012


Dimensions

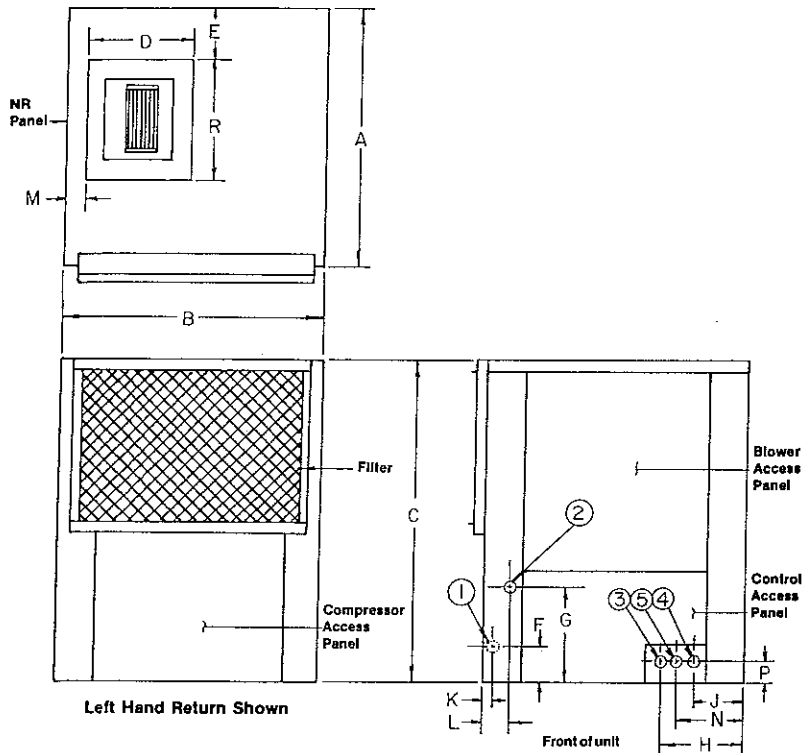


SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R
IN.	19 1/8	19 1/8	23 15/16	7 7/8	3 13/16	3 7/16	9 3/16	7 1/2	3	1 7/8	1 7/16	1 7/8	5 1/4	2 1/16	8 7/8
CM.	49	49	61	19	10	8	25	19	8	4	4	4	13	5	23

FILTER SIZE	10" x 16" x 1"	SHIPPING WGT.	123 lbs.
	25 x 41 x 2.5 CM		56 Kg


Air Flow Patterns

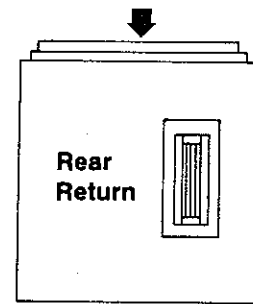

Front of unit



Front of unit



Front of unit

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	0.8	6.3	31.0	8.7	15
265	1	0.8	4.9	27.0	6.9	15

ClimateMaster®

FORMERLY CHP CORP AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 12500 Btuh, Power Input: 1225 Watts, E.E.R.: 10.2 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 400 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	10300	—	—	—	—	—	14312	1176
61	11000	9399	—	—	—	—	15096	1200
64	11700	8101	9899	11696	—	—	15880	1225
67	12500	6803	8600	10500	12298	—	16681	1225
70	13300	5504	7301	9202	11103	12242	17565	1250
73	14000	—	6097	7903	9804	11008	18266	1250

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	360	370	380	400	425	450
Total Capacity	.986	.990	.993	1.00	1.009	1.018
Sensible Capacity	.969	.977	.985	1.00	1.019	1.039
Heat of Rejection	.973	.980	.986	1.00	1.017	1.034
Power Input	.984	.988	.992	1.00	1.010	1.020

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

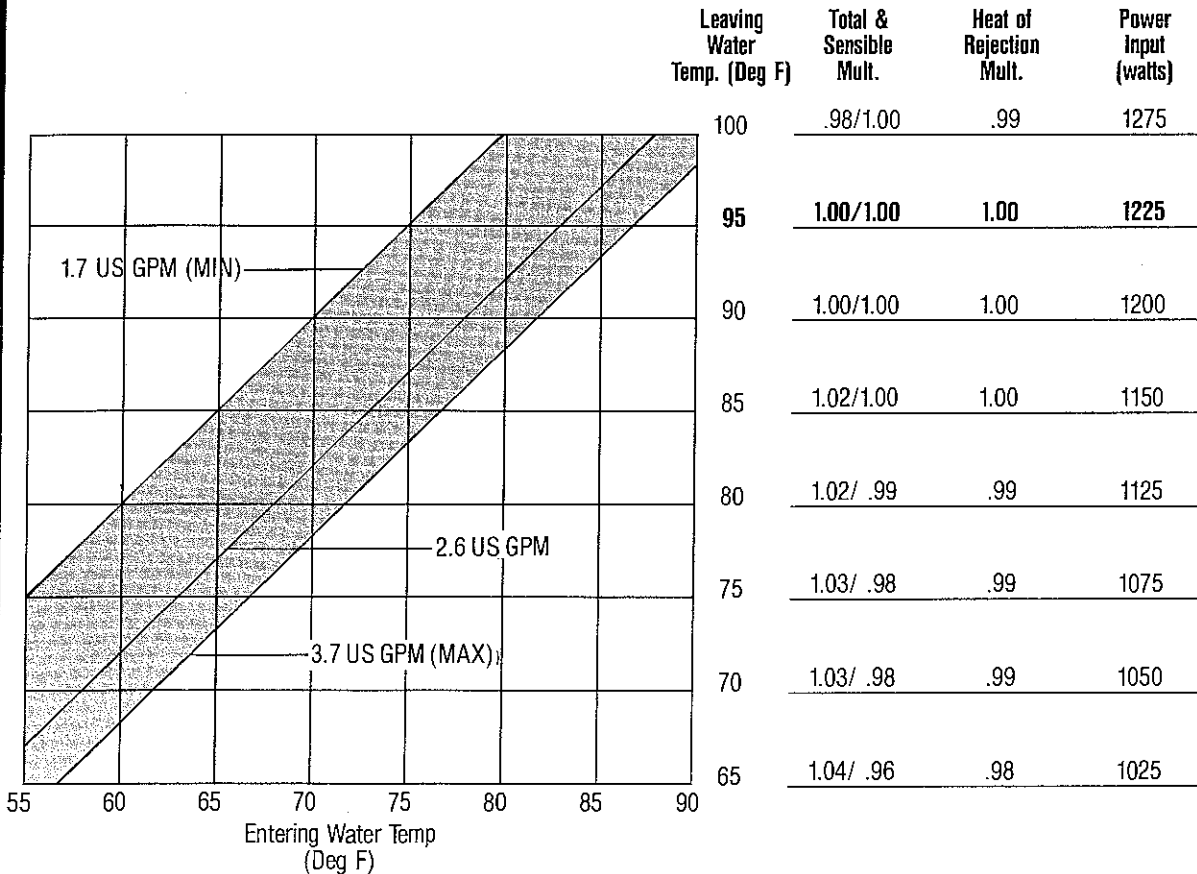

Heating Performance

Heating Capacity: 15700 Btuh, Power Input: 1325 Watts, C.O.P.: 3.5 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.038	1.025	1.013	1.00	.987	.975	.963
Heat of Absorption	1.101	1.066	1.033	1.00	.967	.934	.919
Power Input	.898	.925	.962	1.00	1.038	1.075	1.110

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	360	370	380	400	425	450
Heating Capacity	.986	.990	.993	1.00	1.009	1.018
Heat of Absorption	.975	.981	.988	1.00	1.015	1.031
Power Input	1.012	1.009	1.006	1.00	.993	.985

Figures in Bold Face Type are @ A.R.I. Rating Conditions.


Heating Capacity Correction for Other Leaving Water Temperatures:

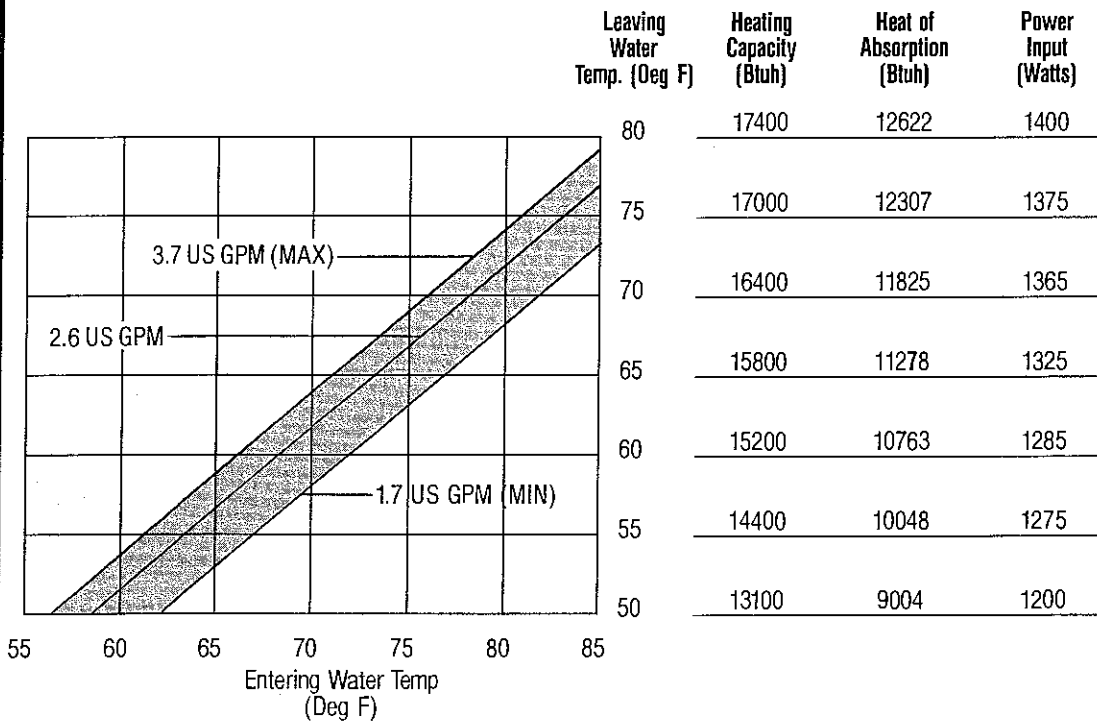

Water Pressure Drop:

Rate, (GPM/12 MBTU)	A.R.I.	Typical Application Flow Rates:				
	3.2	1.6	2.2	2.7	3.2	3.9
Water Flow, (US GPM)	3.3	1.7	2.1	2.6	3.1	3.7
Pressure Drop, (Ft.) (H ₂ O)	4.03	1.22	2.3	2.45	4.0	4.23
		(min.)	(Recommended)			(max.)

Wiring Diagram

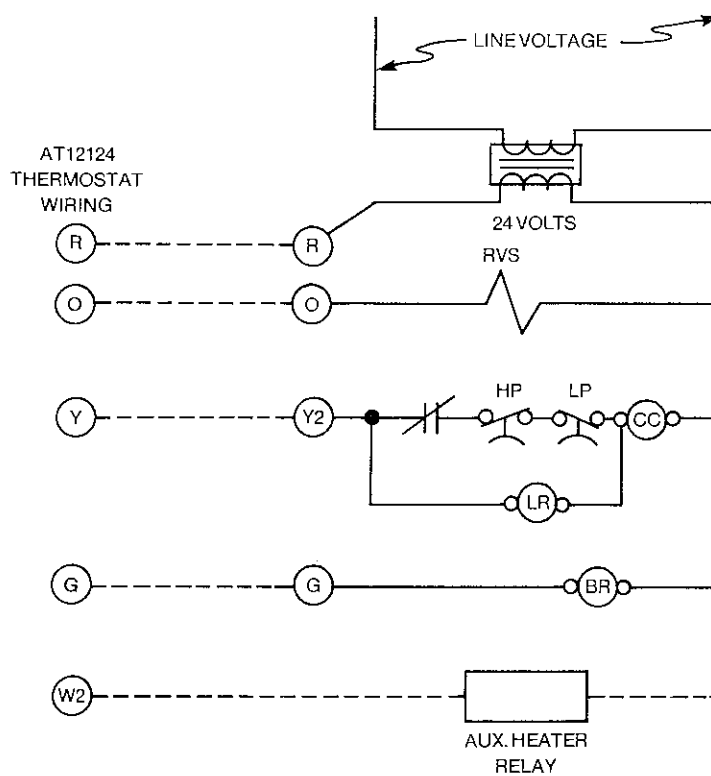

NOTES:
 --- Field Wiring
 Aux. Heater Relay is a field installed option.

- ACO = AUTOMATIC CHANGEOVER RELAY
- AS = ANTI-SHORT CYCLE RELAY
- BM = BLOWER MOTOR
- BMC = BLOWER MOTOR CAPACITOR
- BR = BLOWER RELAY
- CC = COMPRESSOR CONTACTOR
- CCH = CRANKCASE HEATER
- COMP = COMPRESSOR
- CPC = COMPRESSOR CAPACITOR
- CR = CONTROL RELAY

- DL = DEMAND LIMIT RELAY
- FS = FREEZESTAT
- HL = HIGH LEVEL CONDENSATE SWITCH
- HP = HIGH PRESSURE SWITCH
- HT = HIGH TEMPERATURE SWITCH
- LP = LOW PRESSURE SWITCH
- LR = LOCKOUT RELAY
- OL = OVERLOAD
- PR = PROGRAM RELAY
- RS = RANDOM START RELAY

- RVR = REVERSING VALVE RELAY
- RVS = REVERSING VALVE SOLENOID
- SD = SHUTDOWN RELAY
- SLR = SPECIAL LOCKOUT RELAY
- SSM = SAFETY SHUTDOWN MDDULE
- TB = 24-VOLT TERMINAL BLOCK
- TD = TIME DELAY RELAY
- TR = TIMER RELAY
- TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
- NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	450	410	406	384	360						320
Lo	430	412	392	372	350	325					
Med	410	395	378	356	334	320					

Blower Performance is based on wet coil and clean filter

ClimateMaster

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501

(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

Continuing engineering research results in steady improvements. Therefore, these specifications are subject to change without notice.


© 1988 Climate Master Printed in U.S.A. 1/88

803 Series


Standard Operating Range
55°F to 95°F Entering Water Temp.

Size 015


Dimensions

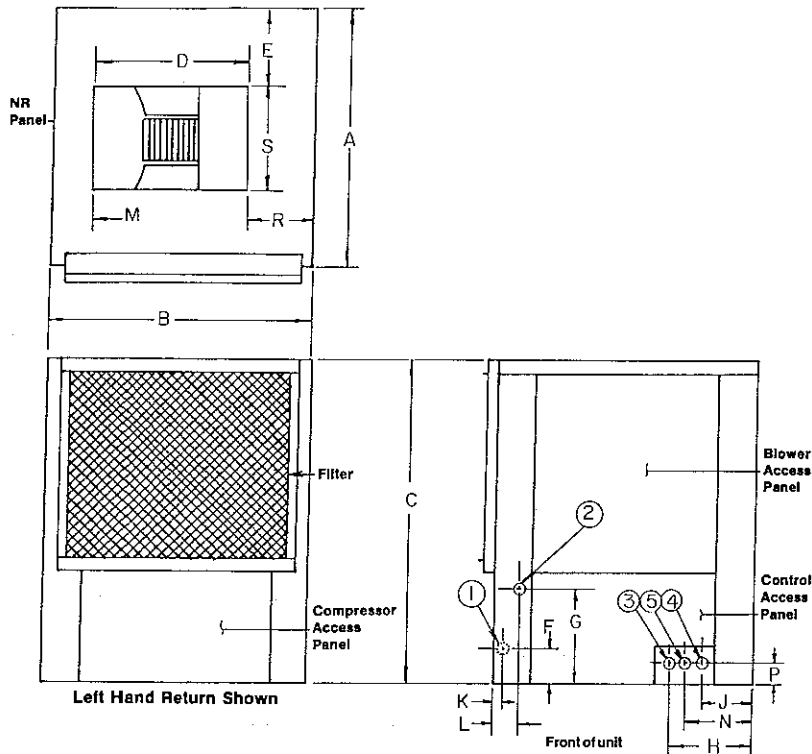


Air Flow Patterns



Front of unit



Front of unit

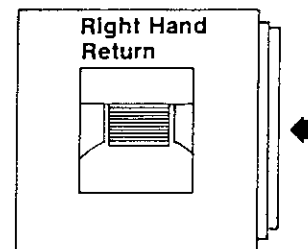

Front of unit

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S
IN.	21 ¹ / ₈	21 ¹ / ₈	34 ³ / ₈	10 ¹ / ₈	5 ¹ / ₂	3 ³ / ₁₆	9 ⁹ / ₁₆	7 ⁷ / ₈	3 ¹ / ₈	1 ¹ / ₁₆	1 ³ / ₁₆	1 ³ / ₄	5 ⁵ / ₈	2 ⁷ / ₁₆	9 ¹ / ₄	7 ⁷ / ₈
CM.	53	53	88	26	14	8	25	19	8	3	4	4	14	7	23	19

FILTER SIZE	20" x 20" x 1"	SHIPPING WGT.	150 lbs.
	51 x 51 x 2.5 CM		68 Kg

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	0.9	5.9	36.0	8.3	15
265	1	0.8	5.0	33.0	7.4	15

ClimateMaster®

FORMERLY CHP CORP AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 14500 Btuh, Power Input: 1400 Watts, E.E.R.: 10.4 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 500 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	12383	—	—	—	—	—	17099	1350
61	13093	11196	—	—	—	—	17793	1375
64	13804	9599	11804	13802	—	—	18488	1375
67	14500	8096	10300	12504	14502	—	19278	1400
70	15196	6499	8796	11000	13205	14626	20068	1425
73	15805	—	7199	9497	11700	13854	20666	1425

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	485	490	500	515	530	560
Total Capacity	.996	.997	1.00	1.004	1.008	1.017
Sensible Capacity	.991	.994	1.00	1.009	1.019	1.037
Heat of Rejection	.992	.995	1.00	1.008	1.016	1.033
Power Input	.995	.997	1.00	1.005	1.010	1.019

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

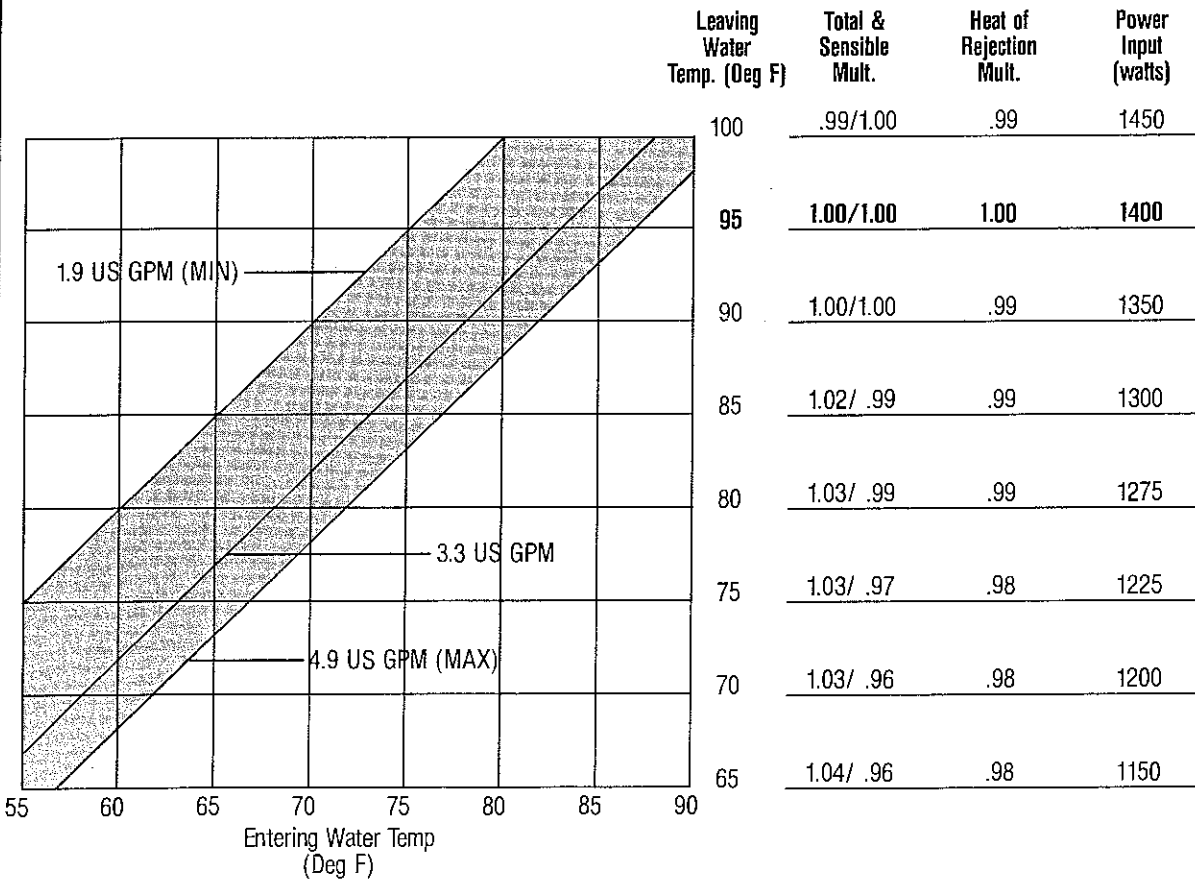

Heating Performance

Heating Capacity: 19000 Btuh, Power Input: 1525 Watts, C.O.P.: 3.7 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.051	1.032	1.011	1.00	.984	.974	.961
Heat of Absorption	1.092	1.056	1.021	1.00	.972	.945	.923
Power Input	.941	.967	.984	1.00	1.016	1.049	1.082

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	485	490	500	515	530	560
Heating Capacity	.996	.997	1.00	1.004	1.008	1.017
Heat of Absorption	.992	.995	1.00	1.008	1.015	1.031
Power Input	1.004	1.003	1.00	.996	.992	.983

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

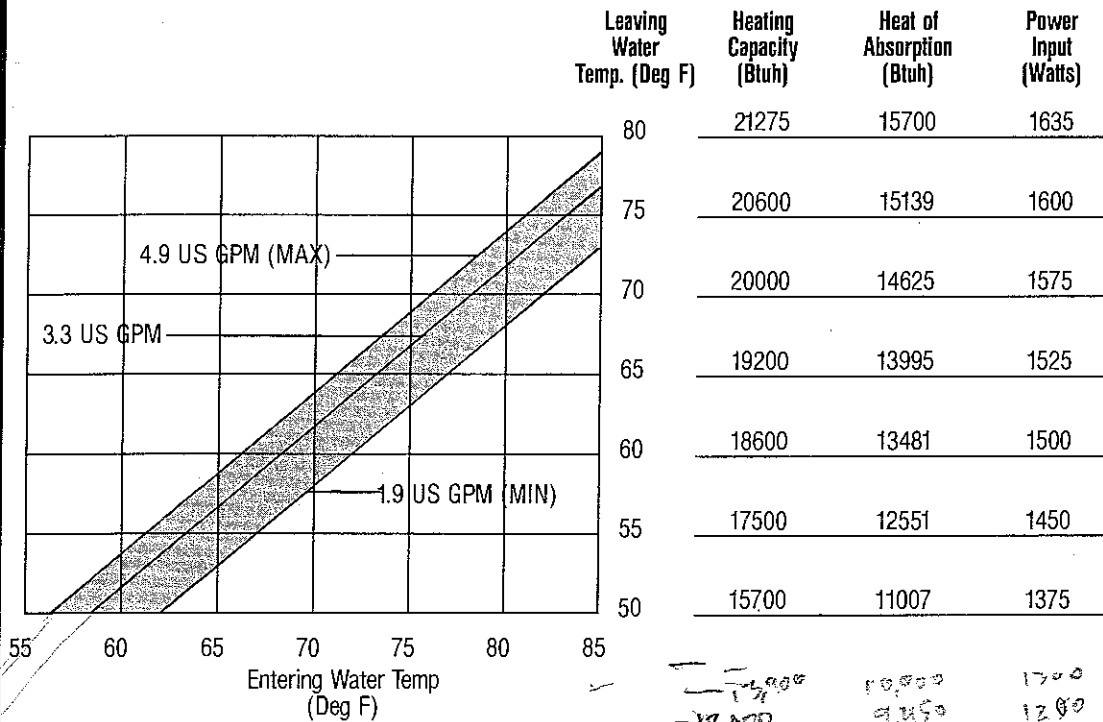

Water Pressure Drop:

A.R.I. Typical Application Flow Rates:


	3.2	1.6	2.4	2.7	3.2	4.0
Rate, (GPM/12 MBTU)	3.2	1.6	2.4	2.7	3.2	4.0
Water Flow, (US GPM)	3.9	1.9	2.9	3.3	3.9	4.9
Pressure Drop, (Ft.) (H ₂ O)	5.47	1.50	3.21	3.4	5.47	8.25

(min.)

(Recommended)

(max.)

Wiring Diagram

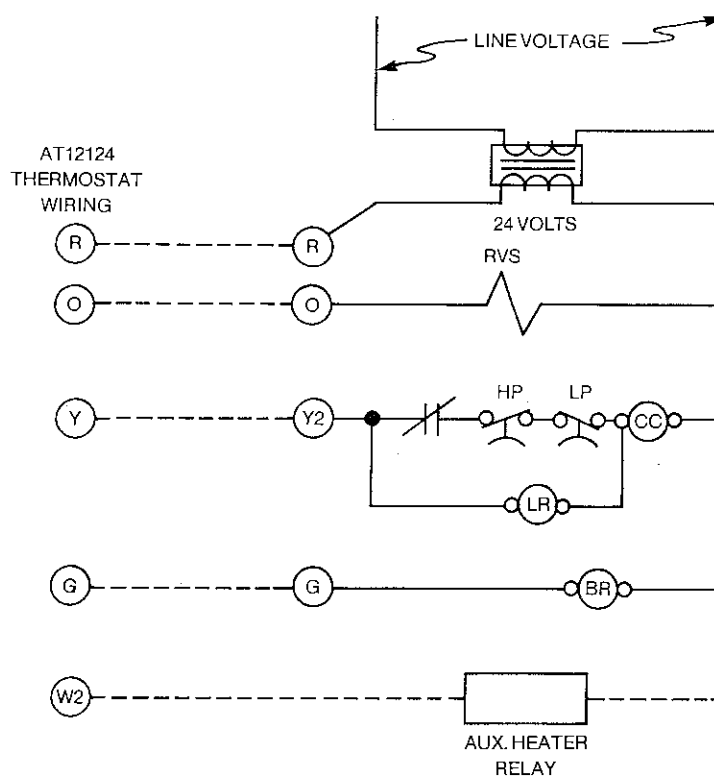

NOTES:
--- Field Wiring
Aux. Heater Relay is a field installed option.

ACO = AUTOMATIC CHANGEOVER RELAY
AS = ANTI-SHORT CYCLE RELAY
BM = BLOWER MOTOR
BMC = BLOWER MOTOR CAPACITOR
BR = BLOWER RELAY
CC = COMPRESSOR CONTACTOR
CCH = CRANKCASE HEATER
COMP = COMPRESSOR
CPC = COMPRESSOR CAPACITOR
CR = CONTROL RELAY

DL = DEMAND LIMIT RELAY
FS = FREEZESTAT
HL = HIGH LEVEL CONDENSATE SWITCH
HP = HIGH PRESSURE SWITCH
HT = HIGH TEMPERATURE SWITCH
LP = LOW PRESSURE SWITCH
LR = LOCKOUT RELAY
OL = OVERLOAD
PR = PROGRAM RELAY
RS = RANDOM START RELAY

RVR = REVERSING VALVE RELAY
RVS = REVERSING VALVE SOLENOID
SD = SHUTDOWN RELAY
SLR = SPECIAL LOCKOUT RELAY
SSM = SAFETY SHUTDOWN MODULE
TB = 24-VOLT TERMINAL BLOCK
TD = TIME DELAY RELAY
TR = TIMER RELAY
TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	560	545	528	507	486						460
Lo	540	528	510	492	473						
Med	516	507	493	478	460						

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

803 Series

Standard Operating Range
55°F to 95°F Entering Water Temp.


Size 019

Dimensions

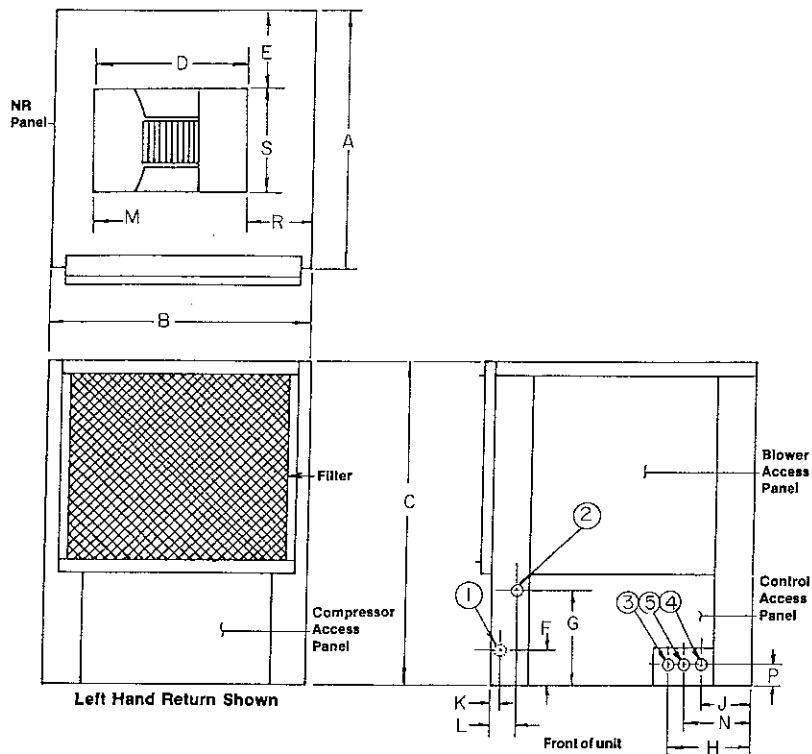

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S
IN.	21 ¹ / ₈	21 ¹ / ₈	34 ³ / ₈	12 ⁷ / ₁₆	6	3 ³ / ₁₆	9 ⁹ / ₁₆	7 ⁷ / ₁₆	3 ³ / ₈	1 ¹ / ₁₆	1 ¹ / ₁₆	3	5 ⁵ / ₁₆	2 ² / ₁₆	5 ⁵ / ₁₆	9 ⁹ / ₁₆
CM.	53	53	88	32	15	10	25	19	8	3	4	8	14	7	14	23

FILTER SIZE	20" x 20" x 1"	SHIPPING WGT.	173 lbs.
	51 x 51 x 2.5 CM		78 Kg

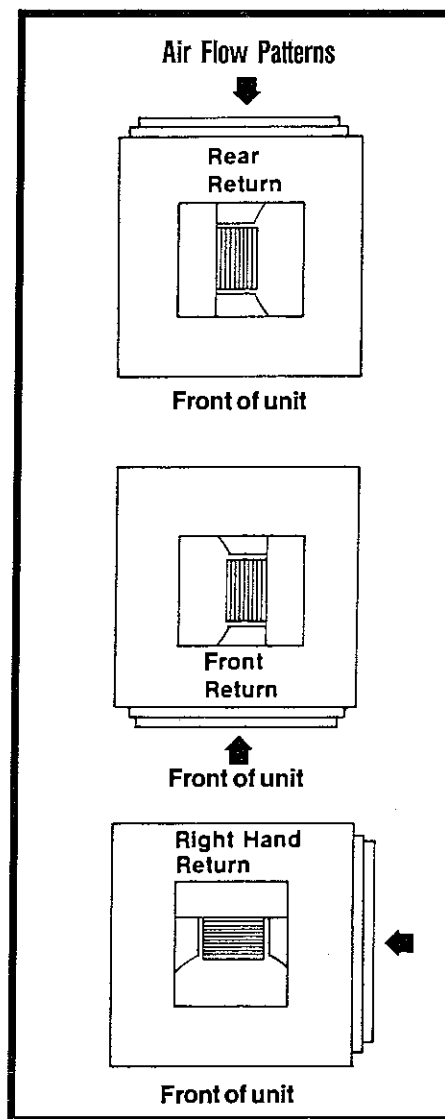

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	1.5	7.6	40.6	11.1	15
265	1	1.2	6.0	34.0	8.7	15

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 19000 Btuh, Power Input: 1750 Watts, E.E.R.: 10.9 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 650 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	16606	—	—	—	—	—	22051	1601
61	17404	15095	—	—	—	—	23025	1650
64	18202	12996	15902	18195	—	—	23999	1699
67	19000	10898	13900	16902	19000	—	24973	1750
70	19893	8799	11801	14803	17806	—	26046	1801
73	20805	—	9799	12802	15804	18807	27121	1850

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	520	625	650	690	770	800
Total Capacity	.972	.995	1.00	1.009	1.026	1.037
Sensible Capacity	.968	.988	1.00	1.019	1.057	1.072
Heat of Rejection	.983	.990	1.00	1.017	1.050	1.063
Power Input	.990	.994	1.00	1.010	1.030	1.037

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

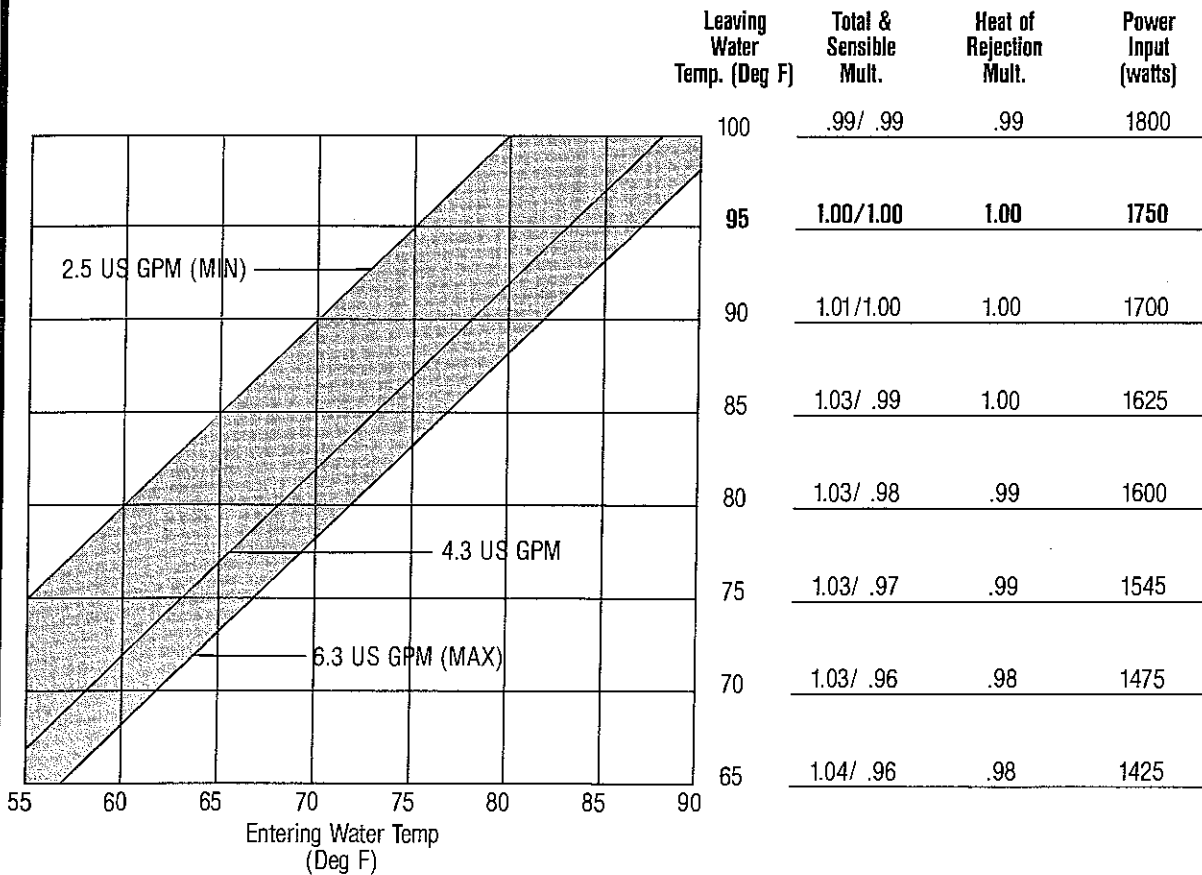

Heating Performance

Heating Capacity: 23000 Btuh, Power Input: 1875 Watts, C.O.P.: 3.6 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.013	1.009	1.009	1.00	.991	.983	.973
Heat of Absorption	1.061	1.043	1.027	1.00	.973	.950	.936
Power Input	.884	.920	.960	1.00	1.040	1.067	1.092

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	520	625	650	690	770	800
Heating Capacity	.99	.995	1.00	1.009	1.026	1.032
Heat of Absorption	.984	.992	1.00	1.012	1.037	1.046
Power Input	1.000	1.000	1.00	1.000	1.000	1.000

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

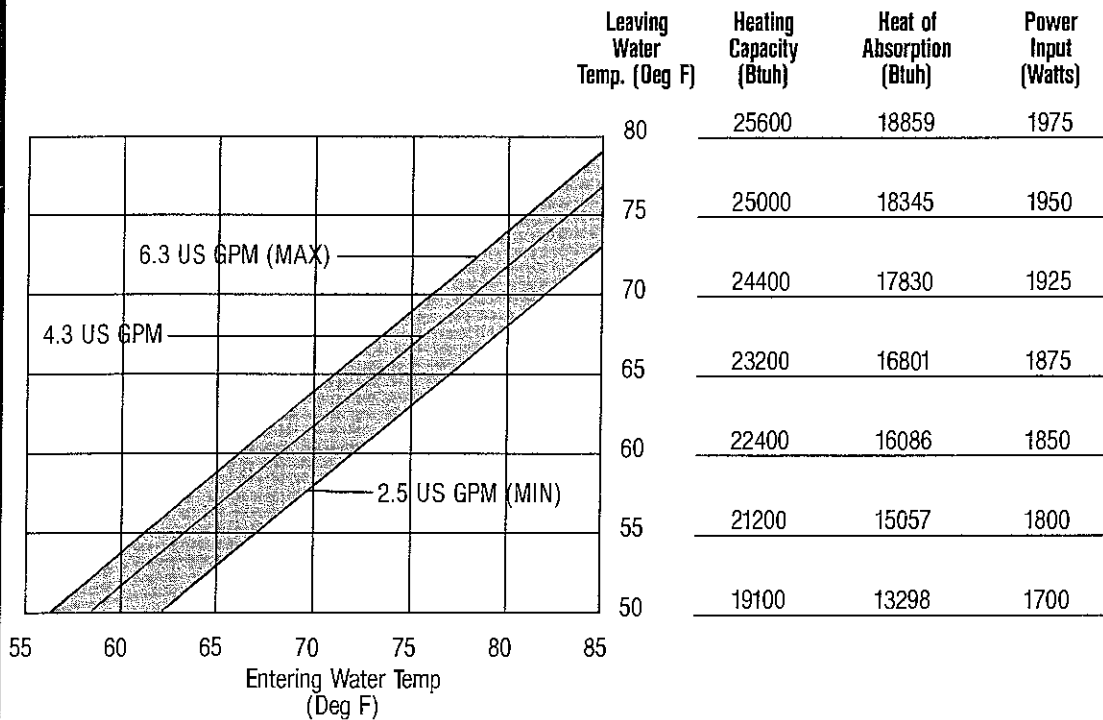

Water Pressure Drop:


	A.R.I.	Typical Application Flow Rates:				
Rate, (GPM/12 MBTU)	3.2	1.6	2.2	2.7	3.2	3.9
Water Flow, (US GPM)	5.0	2.5	3.5	4.3	5.0	6.3
Pressure Drop, (Ft.) (H ₂ O)	8.67	2.49	2.95	3.3	8.67	12.96

(min.)

(Recommended)

(max.)

Wiring Diagram

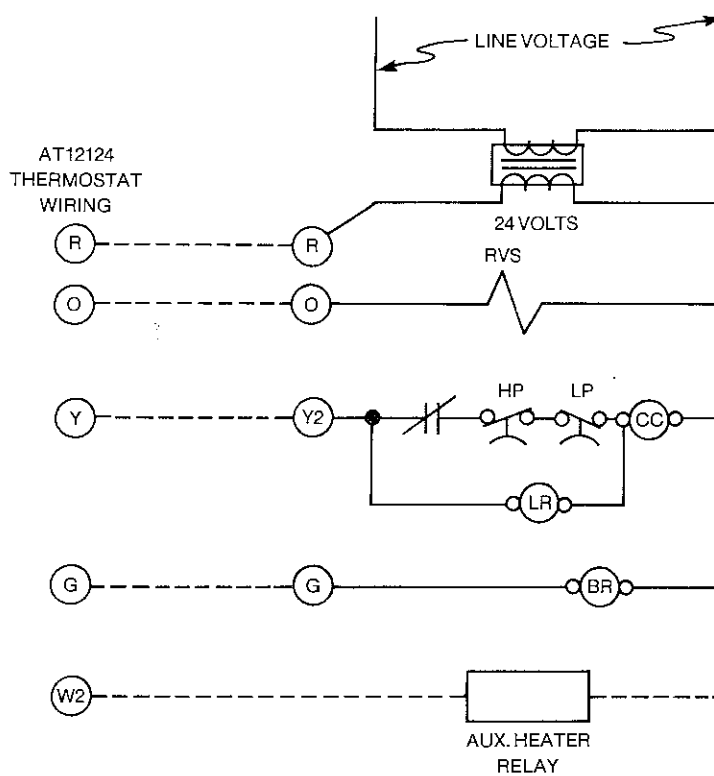

NOTES:
 --- Field Wiring
 Aux. Heater Relay is a field installed option.

ACD = AUTOMATIC CHANGEOVER RELAY
 AS = ANTI-SHORT CYCLE RELAY
 BM = BLOWER MOTOR
 BMC = BLOWER MOTOR CAPACITOR
 BR = BLOWER RELAY
 CC = COMPRESSOR CONTACTOR
 CCH = CRANKCASE HEATER
 COMP = COMPRESSOR
 CPC = COMPRESSOR CAPACITOR
 CR = CONTROL RELAY

DL = DEMAND LIMIT RELAY
 FS = FREEZESTAT
 HL = HIGH LEVEL CONDENSATE SWITCH
 HP = HIGH PRESSURE SWITCH
 HT = HIGH TEMPERATURE SWITCH
 LP = LOW PRESSURE SWITCH
 LR = LOCKOUT RELAY
 OL = OVERLOAD
 PR = PROGRAM RELAY
 RS = RANDOM START RELAY

RVR = REVERSING VALVE RELAY
 RVS = REVERSING VALVE SOLENOID
 SD = SHUTDOWN RELAY
 SLR = SPECIAL LOCKOUT RELAY
 SSM = SAFETY SHUTDOWN MODULE
 TB = 24-VOLT TERMINAL BLOCK
 TD = TIME DELAY RELAY
 TR = TIMER RELAY
 TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
 NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	800	760	715	665	600						520
Lo	700	675	635	600	550						
Med	650	625	600	560	520						

Blower Performance is based on wet coil and clean filter

ClimateMaster

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501

(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

Continuing engineering research results in steady improvements. Therefore, these specifications are subject to change without notice.


© 1988 Climate Master Printed in U.S.A. 1/88

803 Series


Down Flow
Standard Operating Range
 55°F to 95°F Entering Water Temp.

Size 024


Dimensions

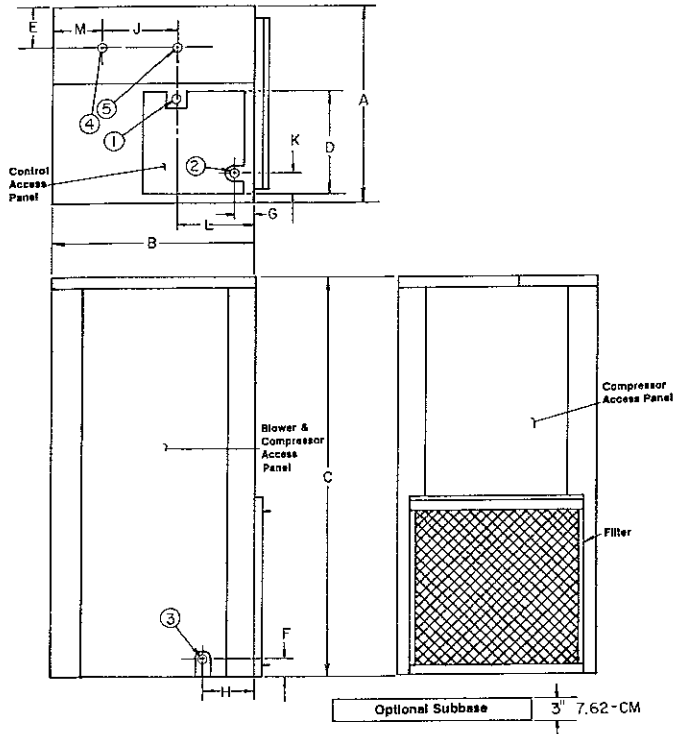

Air Flow Patterns

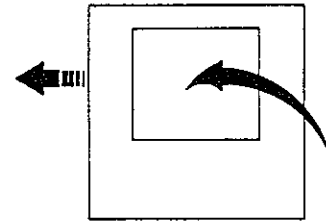

Front of unit

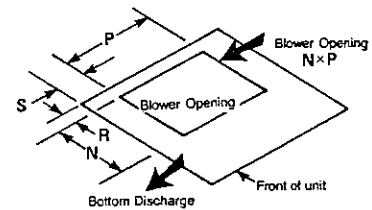

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S
IN.	23 ³ / ₈	23 ³ / ₈	38 ³ / ₈	14 ³ / ₈	4 ⁷ / ₈	1 ¹ / ₈	1 ⁹ / ₁₆	7 ¹ / ₂	7 ¹¹ / ₁₆	3	6 ¹¹ / ₁₆	6 ⁹ / ₁₆				
CM.	58	58	99	37	13	3	4	19	20	8	17	16				

FILTER SIZE	20" x 20" x 1" 51 x 51 x 2.5 CM	SHIPPING WGT.	210 lbs. 95 Kg
-------------	------------------------------------	---------------	-------------------

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	1.6	11.8	54.0	16.4	25
265	1	1.5	9.3	45.0	11.4	20

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
 FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501
 (315) 724-7111

Cooling Performance

Total Cooling Capacity: 25400 Btuh, Power Input: 2275 Watts, E.E.R.: 11.2 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 800 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	—	—	—	—	—	—	26233	2125
61	23266	19114	—	—	—	—	28621	2175
64	24333	16456	20134	23408	—	—	31009	2225
67	25400	13798	17600	21402	25203	—	33165	2275
70	26594	11141	14942	18797	22598	—	35122	2325
73	27813	—	12408	16192	19934	—	34989	2400

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	620	780	800	950	1050	1150
Total Capacity	.981	.997	1.00	1.026	1.044	1.061
Sensible Capacity	.969	.992	1.00	1.058	1.097	1.136
Heat of Rejection	.986	.993	1.00	1.051	1.085	1.119
Power Input	.989	.996	1.00	1.030	1.050	1.070

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

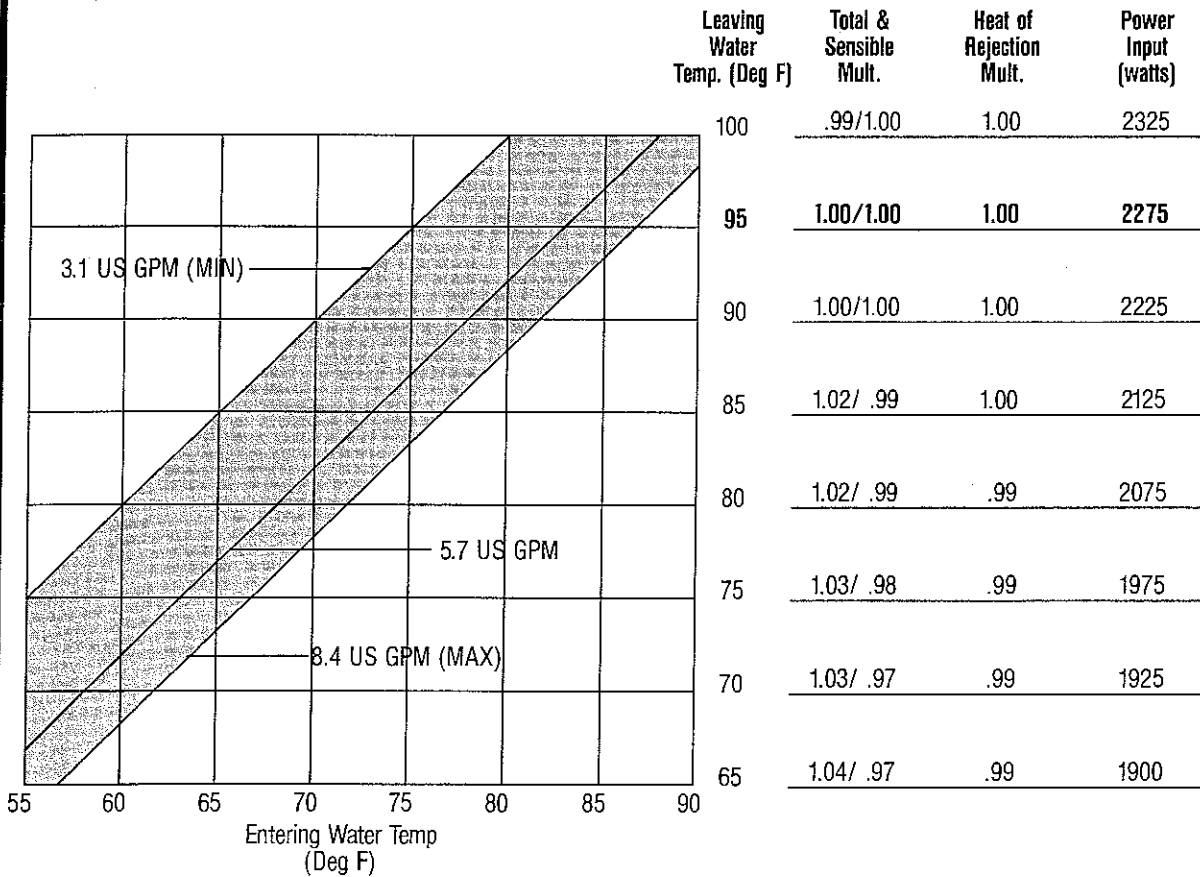

Heating Performance

Heating Capacity: 35000 Btuh, Power Input: 25956 Watts, C.O.P.: 2650 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.030	1.023	1.017	1.00	.971	.931	.892
Heat of Absorption	1.073	1.054	1.036	1.00	.948	.881	.823
Power Input	.906	.934	.962	1.00	1.038	1.075	1.101

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	620	780	800	950	1050	1150
Heating Capacity	.968	.997	1.00	1.026	1.044	1.061
Heat of Absorption	.964	.994	1.00	1.043	1.071	1.099
Power Input	1.003	1.002	1.00	.987	.978	.969

Figures in Bold Face Type are @ A.R.I. Rating Conditions.


Heating Capacity Correction for Other Leaving Water Temperatures:

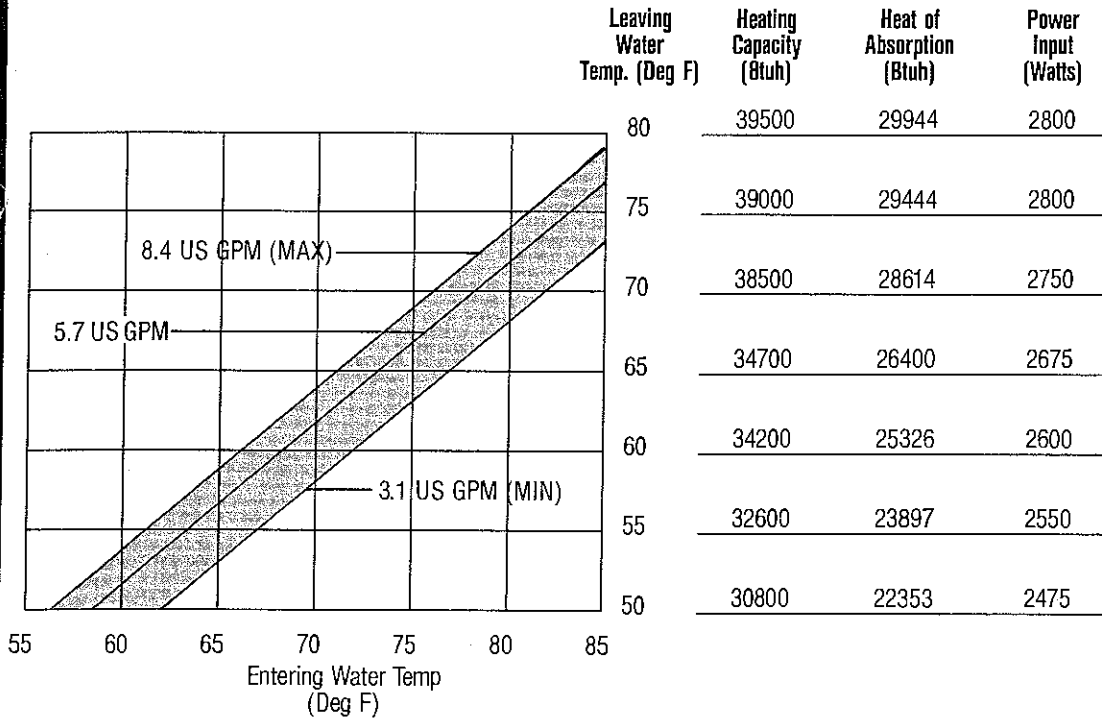

Water Pressure Drop:

Rate, (GPM/12 MBTU)	A.R.I. Typical Application Flow Rates:					
	3.1	1.5	2.2	2.7	3.5	3.9
Water Flow, (US GPM)	6.6	3.1	4.6	5.7	7.4	8.4
Pressure Drop, (Ft.) (H ₂ O)	12.58	3.23	3.9	11.7	13.3	19.21
	(min.)		(Recommended)			(max.)

Wiring Diagram

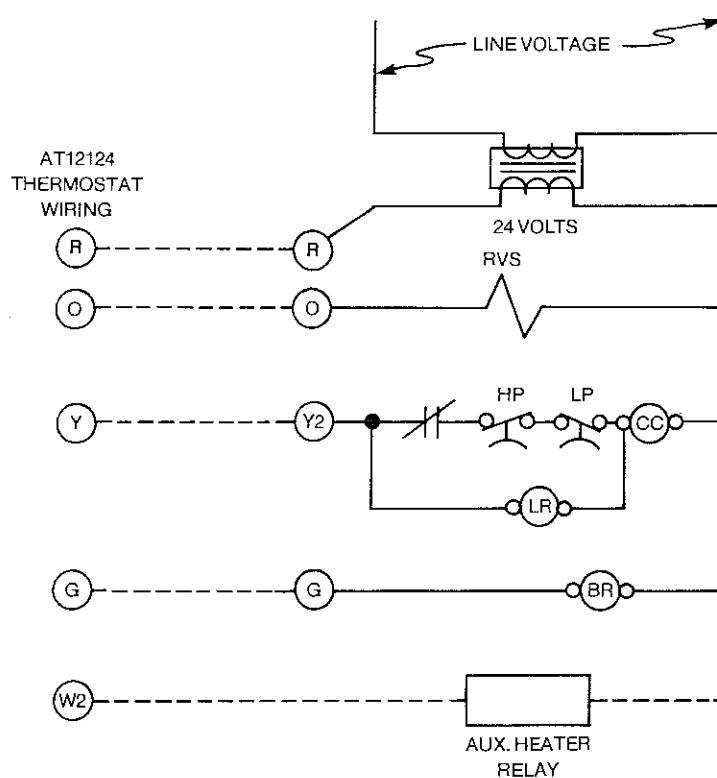

NOTES:
 ---- Field Wiring
 Aux. Heater Relay is a field installed option.

ACO = AUTOMATIC CHANGEOVER RELAY
 AS = ANTI-SHORT CYCLE RELAY
 BM = BLOWER MOTOR
 BMC = BLOWER MOTOR CAPACITOR
 BR = BLOWER RELAY
 CC = COMPRESSOR CONTACTOR
 CCH = CRANKCASE HEATER
 COMP = COMPRESSOR
 CPC = COMPRESSOR CAPACITOR
 CR = CONTROL RELAY

DL = DEMAND LIMIT RELAY
 FS = FREEZESTAT
 HL = HIGH LEVEL CONDENSATE SWITCH
 HP = HIGH PRESSURE SWITCH
 HT = HIGH TEMPERATURE SWITCH
 LP = LOW PRESSURE SWITCH
 LR = LOCKOUT RELAY
 DL = OVERLOAD
 PR = PROGRAM RELAY
 RS = RANDOM START RELAY

RVR = REVERSING VALVE RELAY
 RVS = REVERSING VALVE SOLENOID
 SD = SHUTDOWN RELAY
 SLR = SPECIAL LOCKOUT RELAY
 SSM = SAFETY SHUTDOWN MODULE
 TB = 24-VOLT TERMINAL BLOCK
 TD = TIME DELAY RELAY
 TR = TIMER RELAY
 TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
 NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	1150	1070	970	895	780						620
Lo	1020	945	860	775	730						
Med	890	825	760	690	620						

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

803 Series


Down Flow
Standard Operating Range
 55°F to 95°F Entering Water Temp.

Size 030


Dimensions

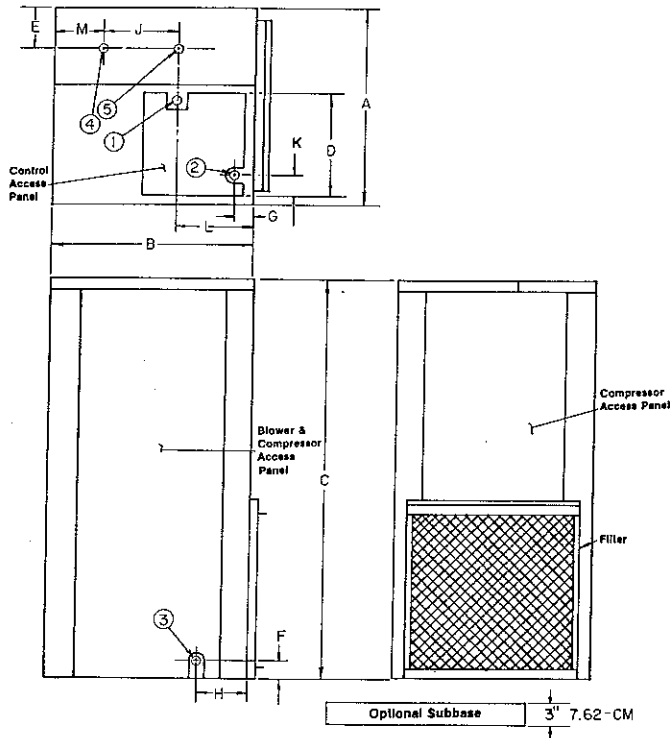

Air Flow Patterns

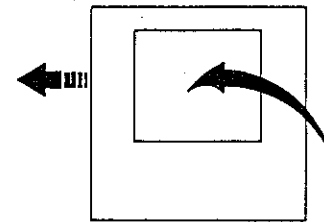

Front of unit

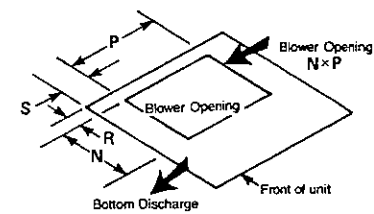

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S
IN.	23 ¹ / ₈	23 ¹ / ₈	38 ⁷ / ₈	14 ³ / ₈	4 ⁷ / ₈	1 ³ / ₁₆	1 ⁹ / ₁₆	7 ¹ / ₂	7 ¹¹ / ₁₆	3	6 ¹¹ / ₁₆	6 ⁹ / ₁₆				
CM.	58	58	99	37	13	3	4	19	20	8	17	16				

FILTER SIZE	20" x 20" x 1"	SHIPPING WGT.	225 lbs.
	51 x 51 x 2.5 CM		100 Kg

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	2.0	14.0	65.0	19.5	30
265	1	2.0	9.2	60.0	13.9	20
208/230	3	1.6	11.2	55.0	17.2	25
460	3	1.0	4.4	28.0	6.5	15

ClimateMaster®

FORMERLY CHP CORP AND FORMERLY
 FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501
 (315) 724-7111

Cooling Performance

Total Cooling Capacity: 30000 Btuh, Power Input: 2900 Watts, E.E.R.: 10.3 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 1000 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	22380	—	—	—	—	—	31639	2697
61	24990	23806	—	—	—	—	34392	2749
64	27600	20405	25201	27599	—	—	37145	2699
67	30000	17200	21800	26596	29997	—	39898	2900
70	33600	—	15391	20209	24808	27795	44007	3051
73	27813	—	12408	16192	19934	—	34989	2400

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	805	880	950	1000	1100	1230
Total Capacity	.979	.983	.993	1.00	1.014	1.027
Sensible Capacity	.952	.963	.985	1.00	1.031	1.056
Heat of Rejection	.946	.967	.986	1.00	1.027	1.051
Power Input	.974	.981	.992	1.00	1.016	1.032

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

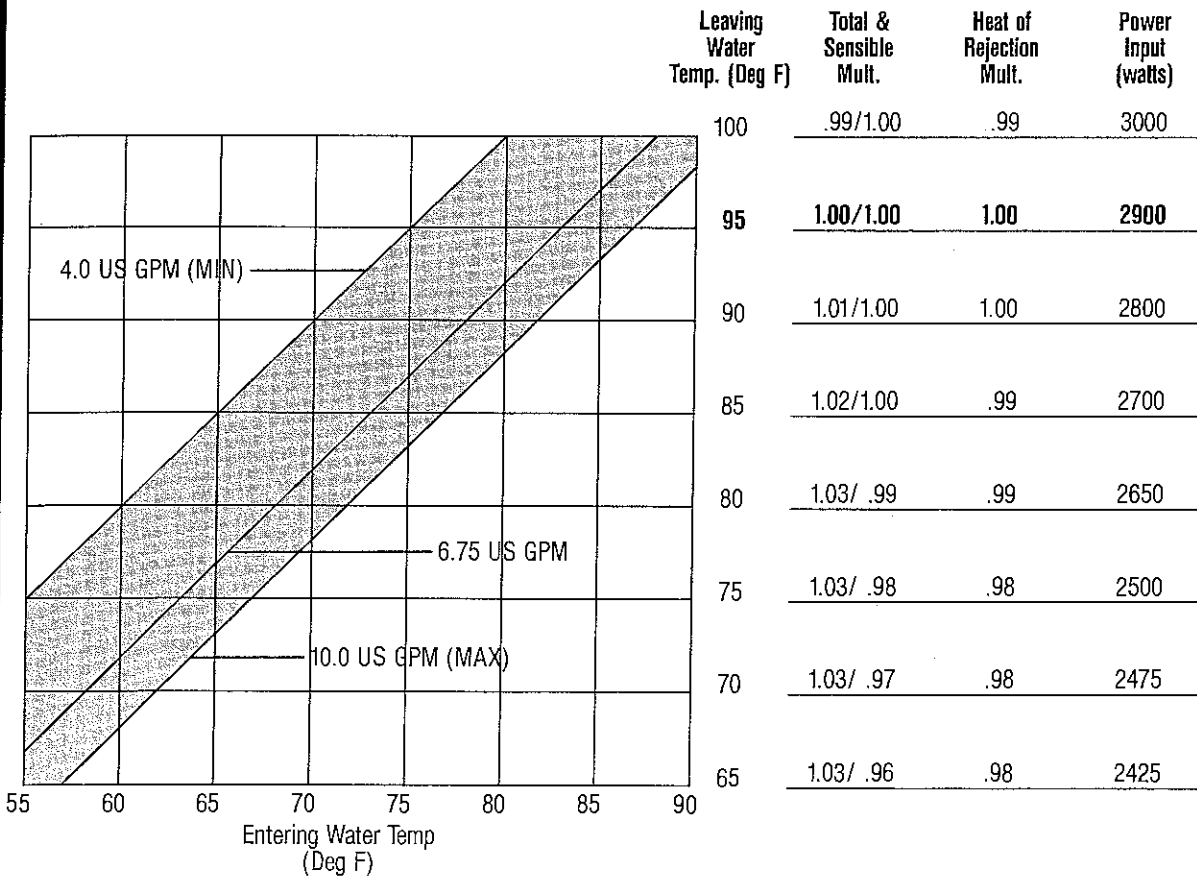

Heating Performance

Heating Capacity: 40500 Btuh, Power Input: 3200 Watts, C.O.P.: 3.7 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.032	1.025	1.012	1.00	.975	.951	.923
Heat of Absorption	1.084	1.057	1.028	1.00	.955	.904	.875
Power Input	.912	.938	.969	1.00	1.031	1.078	1.102

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	805	880	950	1000	1100	1230
Heating Capacity	.975	.983	.993	1.00	1.014	1.023
Heat of Absorption	.959	.974	.989	1.00	1.022	1.036
Power Input	1.009	1.006	1.003	1.00	.995	.992

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

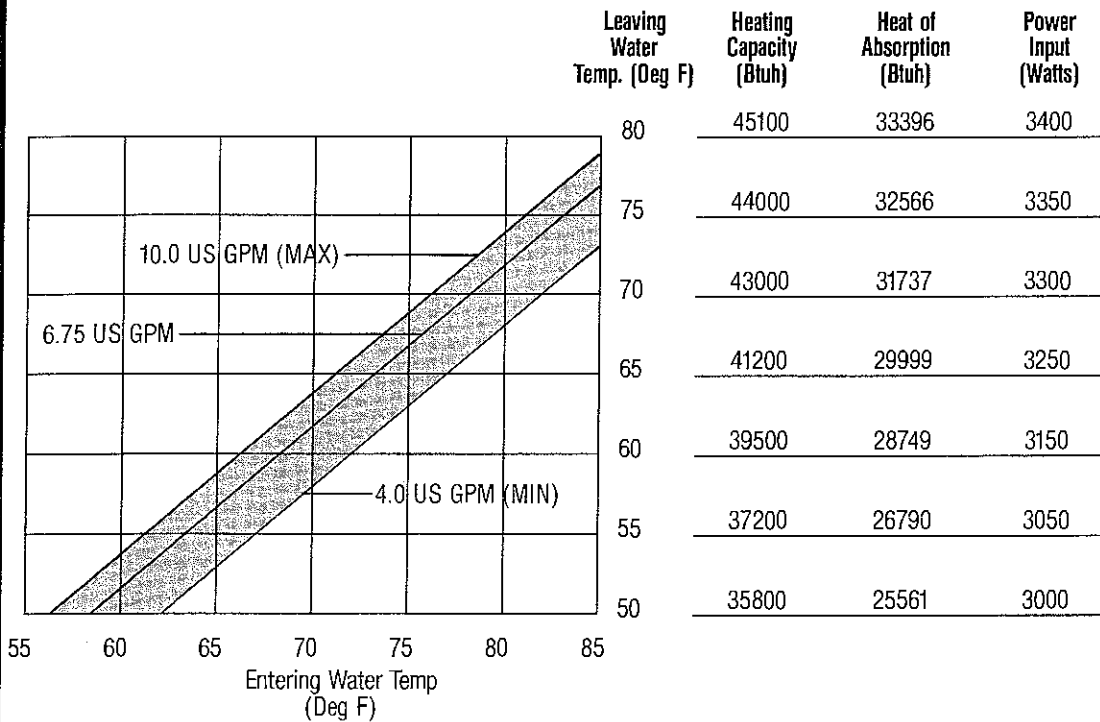

Water Pressure Drop:


	A.R.I.	Typical Application Flow Rates:				
Rate, (GPM/12 MBTU)	3.2	1.6	2.2	2.7	3.5	4.0
Water Flow, (US GPM)	8.0	4.0	5.5	6.75	8.75	10.0
Pressure Drop, (Ft.) (H ₂ O)	7.8	1.8	3.5	5.3	8.9	11.6

(min.)

(Recommended)

(max.)

Wiring Diagram

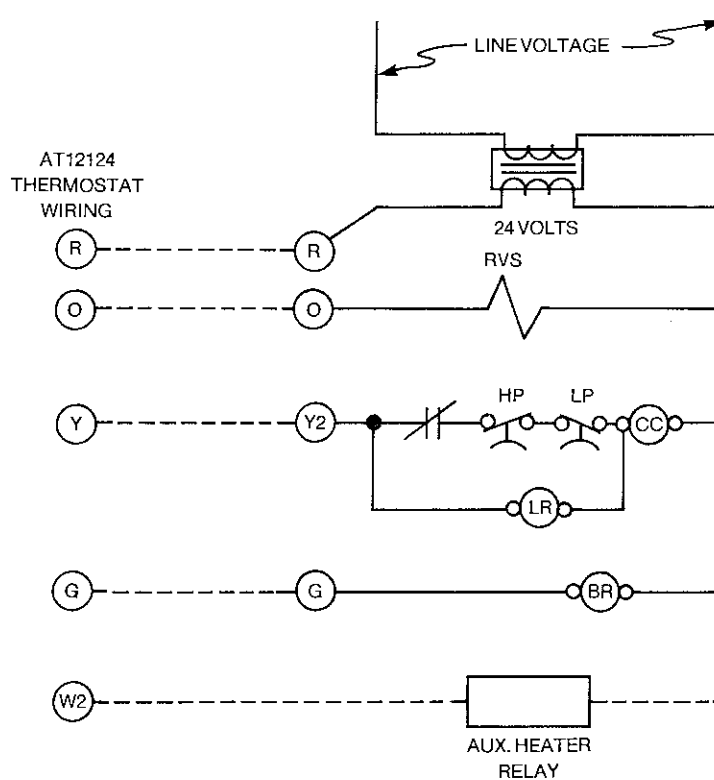

NOTES:

---- Field Wiring
Aux. Heater Relay is a field installed option.

ACD = AUTOMATIC CHANGEOVER RELAY
AS = ANTI-SHORT CYCLE RELAY
BM = BLOWER MOTOR
BMC = BLOWER MOTOR CAPACITOR
BR = BLOWER RELAY
CC = COMPRESSOR CONTACTOR
CCH = CRANKCASE HEATER
COMP = COMPRESSOR
CPC = COMPRESSOR CAPACITOR
CR = CONTROL RELAY

DL = DEMAND LIMIT RELAY
FS = FREEZESTAT
HL = HIGH LEVEL CONDENSATE SWITCH
HP = HIGH PRESSURE SWITCH
HT = HIGH TEMPERATURE SWITCH
LP = LOW PRESSURE SWITCH
LR = LOCKOUT RELAY
OL = OVERLOAD
PR = PROGRAM RELAY
RS = RANDOM START RELAY

RVR = REVERSING VALVE RELAY
RVS = REVERSING VALVE SOLENOID
SD = SHUTDOWN RELAY
SLR = SPECIAL LOCKOUT RELAY
SSM = SAFETY SHUTDOWN MODULE
TB = 24-VOLT TERMINAL BLOCK
TD = TIME DELAY RELAY
TR = TIMER RELAY
TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	1230	1165	1100	1035	955	880					805
Lo	1110	1055	990	930	865	805					
Med	1020	965	910	850							

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

803 Series

Down Flow
Standard Operating Range
 55°F to 95°F Entering Water Temp.

Size 036


Dimensions

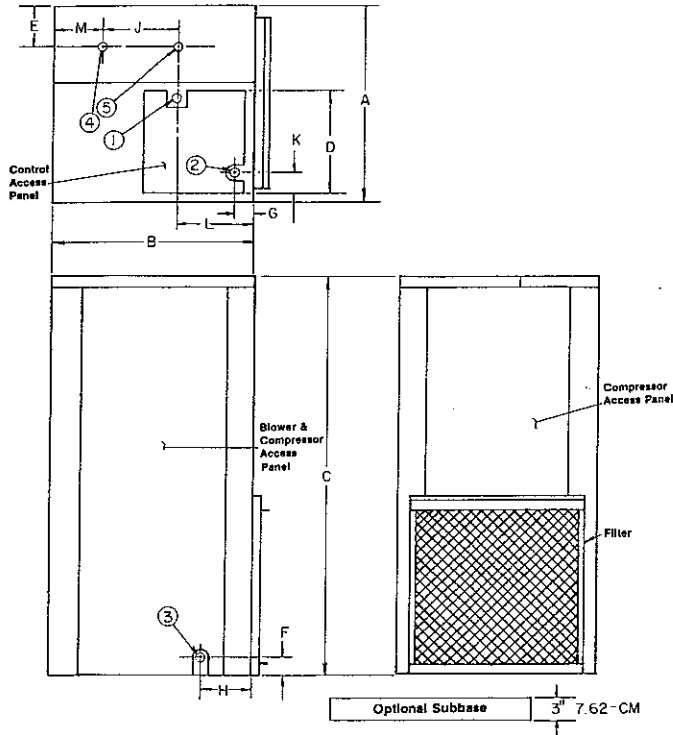


SZ.	A	B	C	D	E	F	G	H	J	K	L	M				
IN.	25 ⁵ / ₁₆	25 ⁵ / ₁₆	43 ¹ / ₄	14 ³ / ₈	5 ¹³ / ₁₆	1 ⁹ / ₁₆	1 ⁹ / ₁₆	7 ¹ / ₂	9 ¹ / ₄	3	6 ¹¹ / ₁₆	6 ⁷ / ₁₆				
CM.	64	64	110	37	15	3	4	19	23	8	17	16				

FILTER SIZE	24" x 24" x 1" 61 x 61 x 2.5 CM	SHIPPING WGT.	248 lbs. 112 Kg
-------------	------------------------------------	---------------	--------------------

Air Flow Patterns

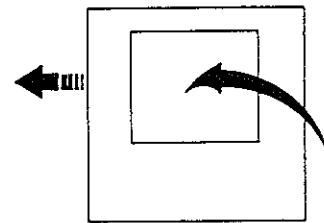

Front of unit

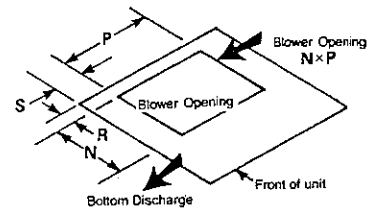

Bottom Discharge

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	3.2	15.5	78.0	22.6	35
265	1	3.2	14.1	73.8	20.8	30
208/230	3	3.2	10.6	59.5	16.5	25
460	3	1.8	4.6	30.7	7.6	15

ClimateMaster

FORMERLY CHP CORP. AND FORMERLY
 FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501
 (315) 724-7111

Cooling Performance

Total Cooling Capacity: 36000 Btuh, Power Input: 3200 Watts, E.E.R.: 11.3 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 1250 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	—	—	—	—	—	—	43450	3046
61	33804	28888	—	—	—	—	45420	3098
64	34884	24871	30590	—	—	—	46171	3149
67	36000	20881	26600	32319	38038	—	46922	3200
70	37152	16944	22663	28382	34101	35245	48001	3251
73	38304	—	18780	24499	30218	33702	48423	3302

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1000	1200	1250	1300	1400	1500
Total Capacity	.973	.994	1.00	1.006	1.017	1.028
Sensible Capacity	.948	.988	1.00	1.012	1.037	1.062
Heat of Rejection	.963	.989	1.00	1.011	1.033	1.054
Power Input	.978	.994	1.00	1.006	1.019	1.032

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

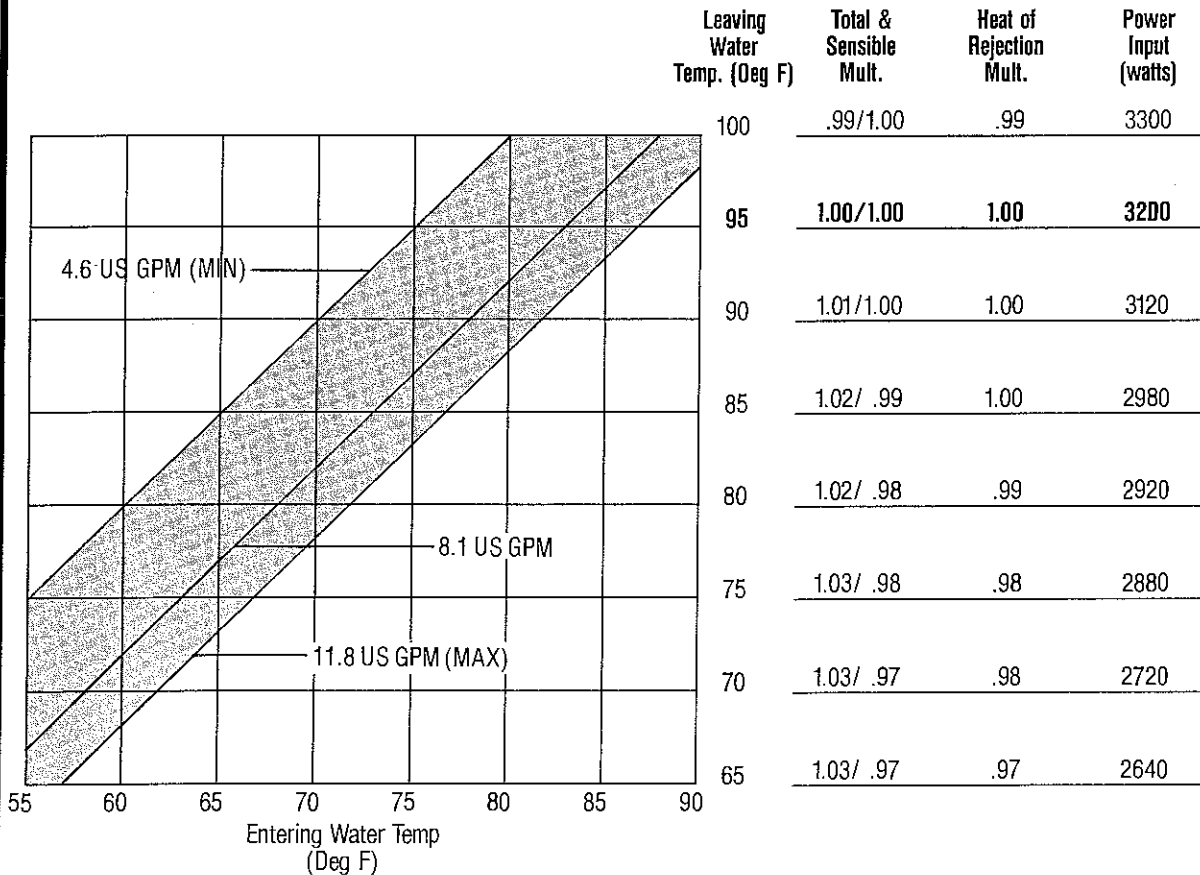

Heating Performance

Heating Capacity: 42500 Btuh, Power Input: 3200 Watts, C.O.P.: 3.9 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.046	1.033	1.015	1.00	.987	.976	.964
Heat of Absorption	1.075	1.051	1.020	1.00	.975	.956	.935
Power Input	.966	.978	.989	1.00	1.011	1.022	1.03

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1000	1200	1250	1300	1400	1500
Heating Capacity	.980	.994	1.00	1.006	1.017	1.028
Heat of Absorption	.969	.993	1.00	1.007	1.022	1.036
Power Input	.990	.998	1.00	1.002	1.005	1.008

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

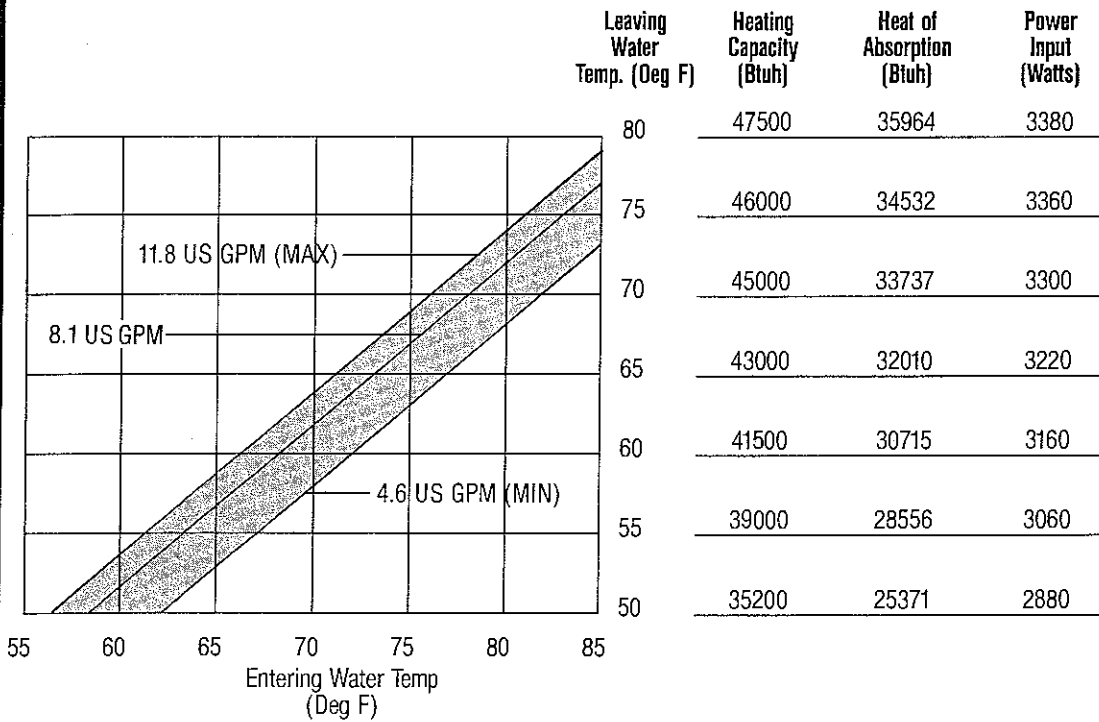

Water Pressure Drop:

A.R.I. Typical Application Flow Rates:


Rate, (GPM/12 MBTU)	3.1	1.5	2.2	2.7	3.2	3.9
Water Flow, (US GPM)	9.4	4.6	6.6	8.1	9.6	11.8
Pressure Drop, (Ft.) (H ₂ O)	20.48	14.33	17.16	19.01	20.69	22.95

(min.)

(Recommended)

(max.)

Wiring Diagram

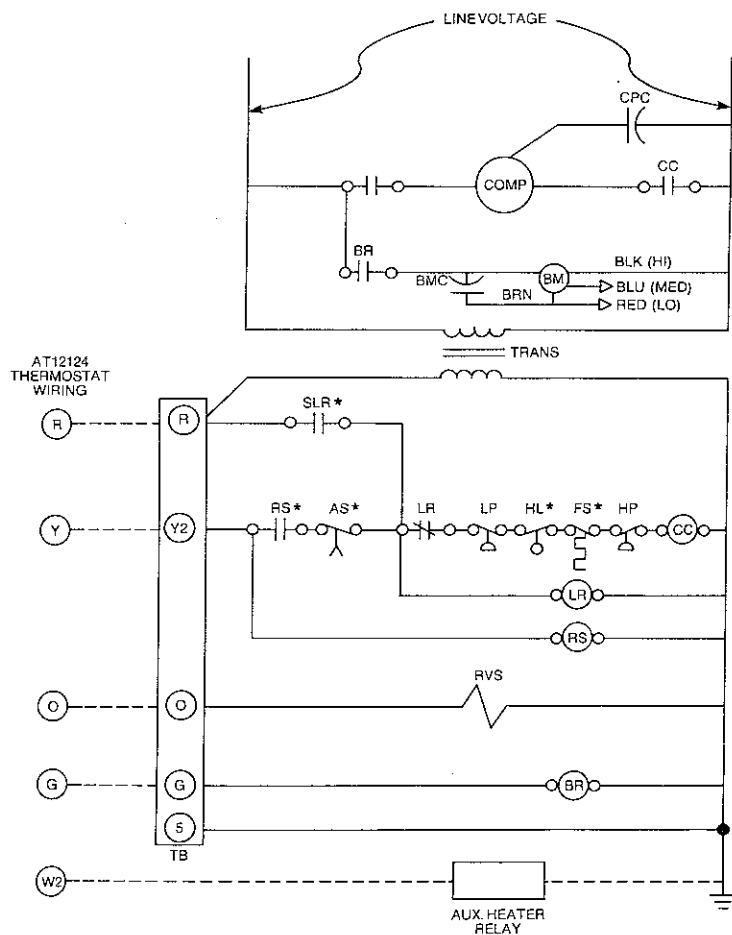

NOTES:
 --- Field Wiring
 Aux. Heater Relay is a field installed option.

- | | | |
|----------------------------------|-----------------------------------|---|
| ACO = AUTOMATIC CHANGEOVER RELAY | DL = DEMAND LIMIT RELAY | RVR = REVERSING VALVE RELAY |
| AS = ANTI-SHORT CYCLE RELAY | ES = FREEZESTAT | RVS = REVERSING VALVE SOLENOID |
| BM = BLOWER MOTOR | HL = HIGH LEVEL CONDENSATE SWITCH | SD = SHUTDOWN RELAY |
| BMC = BLOWER MOTOR CAPACITOR | HP = HIGH PRESSURE SWITCH | SLR = SPECIAL LOCKOUT RELAY |
| BR = BLOWER RELAY | HT = HIGH TEMPERATURE SWITCH | SSM = SAFETY SHUTDOWN MODULE |
| CC = COMPRESSOR CONTACTOR | LP = LOW PRESSURE SWITCH | TB = 24-VOLT TERMINAL BLOCK |
| CCH = CRANKCASE HEATER | LR = LOCKOUT RELAY | TD = TIME DELAY RELAY |
| COMP = COMPRESSOR | OL = OVERLOAD | TR = TIMER RELAY |
| CPC = COMPRESSOR CAPACITOR | PR = PROGRAM RELAY | TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER |
| CR = CONTROL RELAY | RS = RANDOM START RELAY | NOTE = * (DENOTES AVAILABLE AS OPTION) |

Blower Performance

Fan Speed	External Static Pressure (In wg)										Min. CFM
	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	
Hi	1500	1420	1340	1250	1170	1080					1000
Lo	1360	1310	1250	1190	1110	1000					
Med	1290	1240	1190	1120	1030						

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
 FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

803 Series



Down Flow
Standard Operating Range
 55°F to 95°F Entering Water Temp.

Size 042

Dimensions

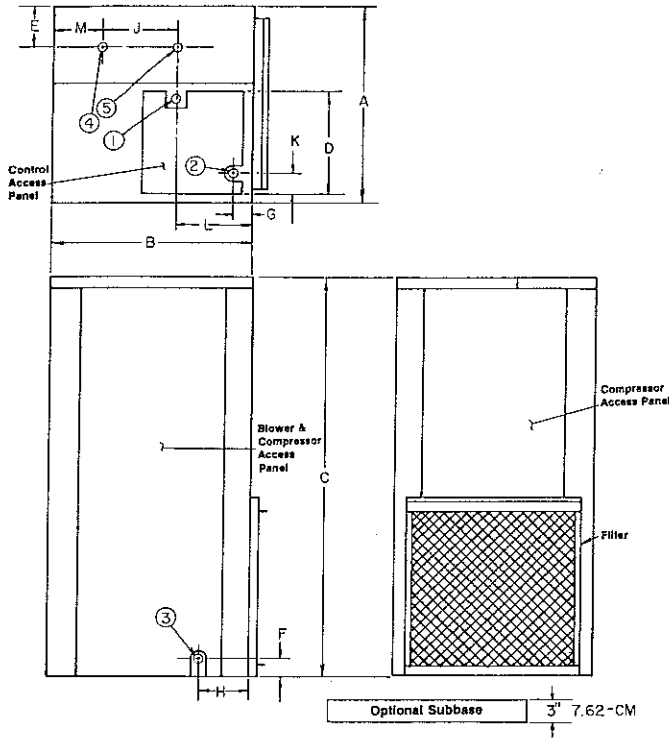

Air Flow Patterns

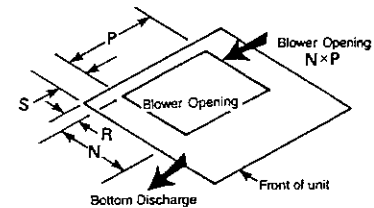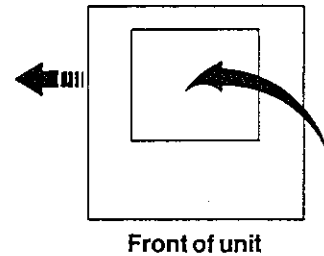

SZ.	A	B	C	D	E	F	G	H	J	K	L	M				
IN.	25 ⁵ / ₁₆	25 ⁵ / ₁₆	43 ¹ / ₄	14 ³ / ₈	5 ¹³ / ₁₆	1 ⁷ / ₁₆	1 ¹ / ₁₆	7 ¹ / ₂	10 ¹ / ₂	3	6 ¹ / ₁₆	6 ⁵ / ₁₆				
CM.	64	64	110	37	15	3	4	19	27	8	17	16				

FILTER SIZE	24" x 24" x 1"	SHIPPING WGT.	278 lbs.
	61 x 61 x 2.5 CM		126 Kg

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	3.2	17.6	88.0	25.2	40
208/230	3	3.2	11.5	65.1	17.6	25
460	3	1.8	5.1	32.8	8.2	15

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
 FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501
 (315) 724-7111

Cooling Performance

Total Cooling Capacity: 41500 Btuh, Power Input: 3520 Watts, E.E.R.: 11.8 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 1500 CFM & 95°F Leaving Water Temp)

Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	35856	—	—	—	—	—	47520	3355
61	37848	33666	—	—	—	—	49500	3411
64	39840	28985	35650	—	—	—	52711	3467
67	41500	24335	31000	37665	44330	—	53514	3520
70	42869	19747	26412	33077	39742	42625	54317	3573
73	44114	15190	21886	28551	35216	36735	55173	3629


Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1260	1340	1450	1500	1700	1800
Total Capacity	.974	.985	.995	1.00	1.019	1.026
Sensible Capacity	.934	.967	.990	1.00	1.041	1.058
Heat of Rejection	.956	.971	.991	1.00	1.036	1.051
Power Input	.974	.983	.995	1.00	1.021	1.030

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

Leaving Water Temp. (Deg F)	Total & Sensible Mult.	Heat of Rejection Mult.	Power Input (watts)
100	.99/1.00	.99	3640
95	1.00/1.00	1.00	3520
90	1.01/1.00	1.00	3440
85	1.02/ .99	1.00	3280
80	1.02/ .99	.99	3220
75	1.03/ .98	.99	3080
70	1.03/ .98	.98	3000
65	1.03/ .97	.97	2900

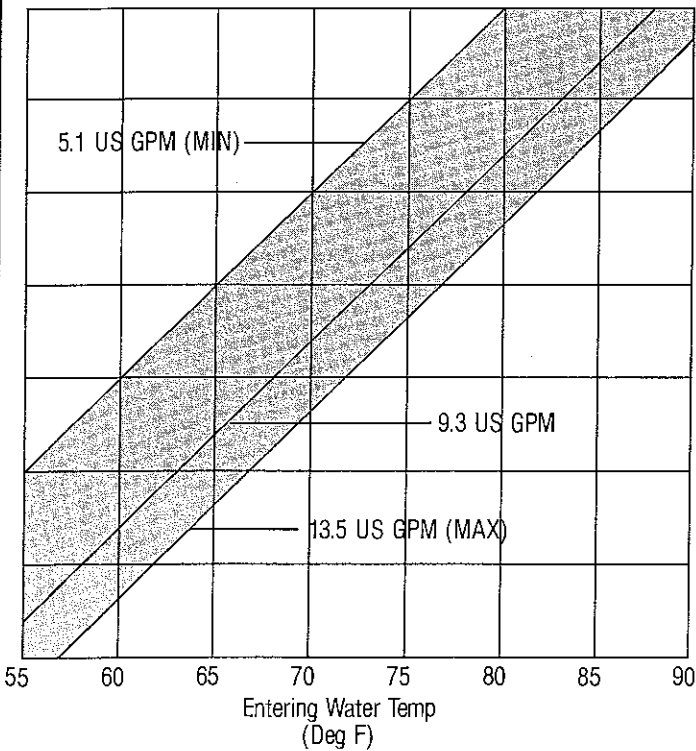

Heating Performance

Heating Capacity: 44500 Btuh, Power Input: 3340 Watts, C.O.P.: 3.9 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.063	1.040	1.025	1.00	.965	.919	.862
Heat of Absorption	1.107	1.076	1.045	1.00	.937	.864	.823
Power Input	.900	.930	.965	1.00	1.035	1.070	1.102

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1260	1340	1450	1500	1700	1800
Heating Capacity		.985	.995	1.00	1.019	1.026
Heat of Absorption		.980	.994	1.00	1.025	1.035
Power Input		.998	.999	1.00	1.003	1.004

Figures in Bold Face Type are @ A.R.I. Rating Conditions.


Heating Capacity Correction for Other Leaving Water Temperatures:

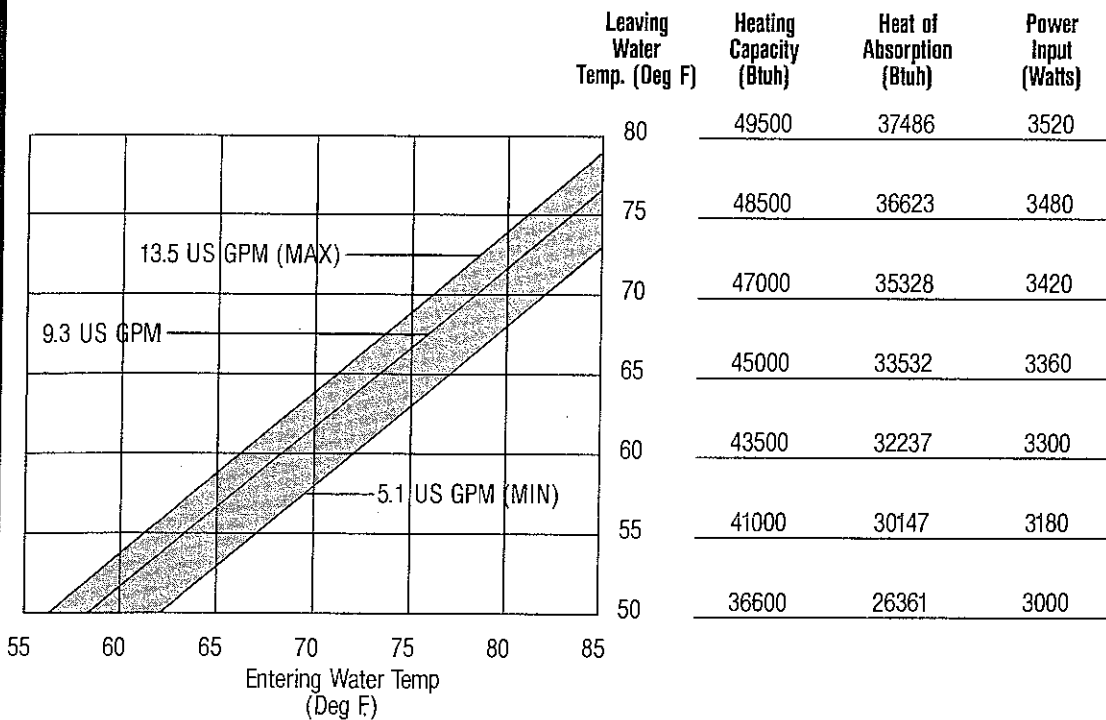

Water Pressure Drop:

	A.R.I.	Typical Application Flow Rates:				
Rate, (GPM/12 MBTU)	3.1	1.5	2.2	2.7	3.5	3.9
Water Flow, (US GPM)	10.7	5.1	7.6	9.3	12.1	13.5
Pressure Drop, (Ft.) (H ₂ O)	22.30	5.88	12.92	20.78	30.14	33.89
		(min.)	(Recommended)			(max.)

Wiring Diagram

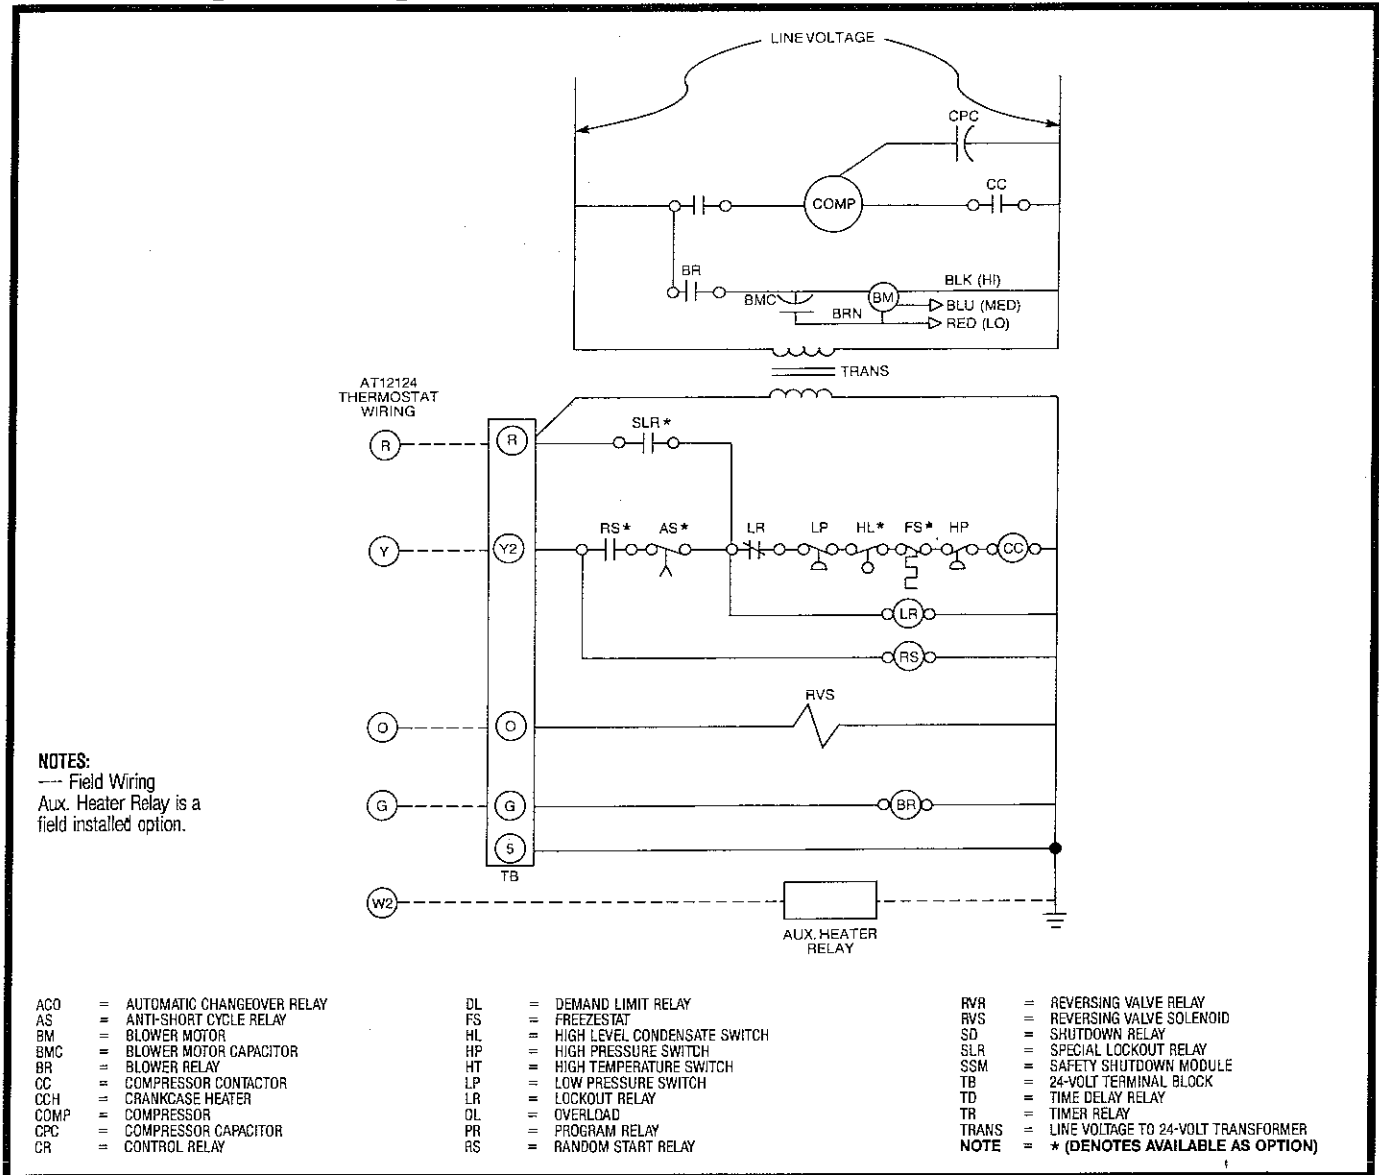

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	1780	1700	1620	1540	1440	1340					1260
Lo	1670	1610	1540	1460	1370	1260					
Med	1540	1500	1450	1400	1330						

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

813 Series

Standard Operating Range
55°F to 95°F Entering Water Temp.


Size 036

Dimensions

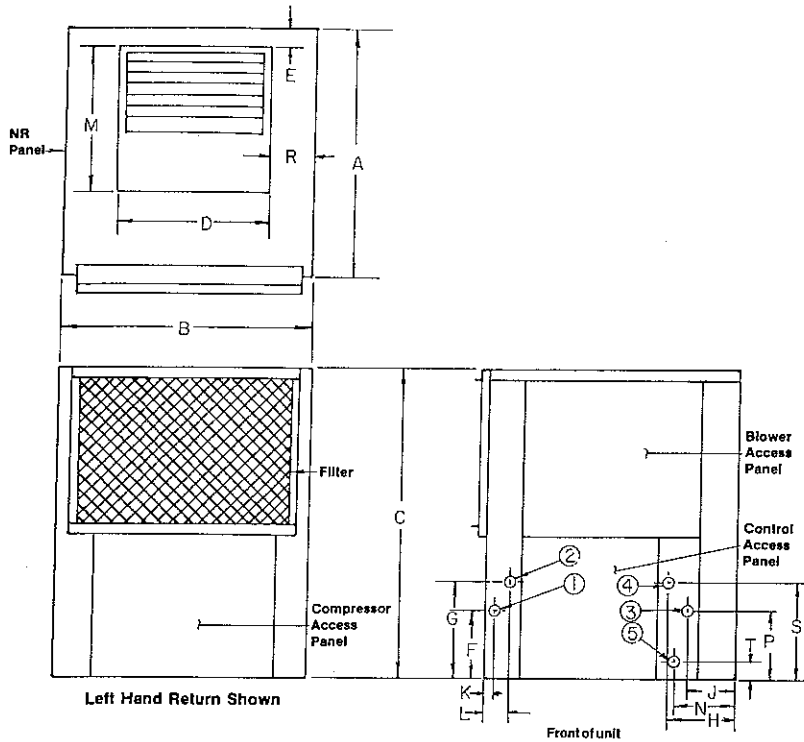

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T
IN.	25¼	25¼	42	11¾	4¼	11	15	5¾	4¼	1¾	1¾	12¾	5	9¼	6¾	13¼	2
CM.	64	64	107	29	11	28	38	14	11	3	4	32	13	23	17	34	5

FILTER SIZE	24" x 24" x 1"	SHIPPING WGT.	248 lbs.
	61 x 61 x 2.5 CM		112 Kg

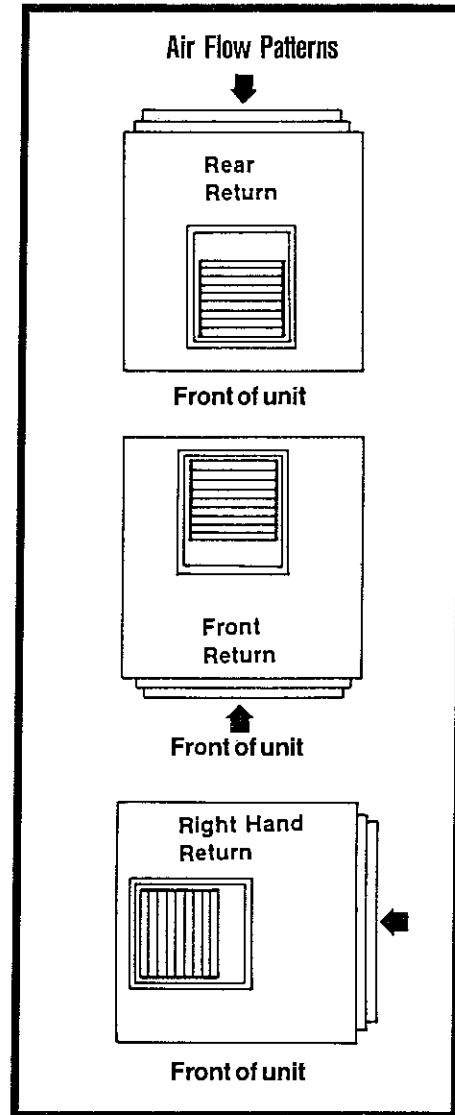

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	3.2	15.5	78.0	22.6	35
265	1	3.2	14.1	73.8	20.8	30
208/230	3	3.2	10.6	59.5	16.5	25
460	3	1.8	4.6	30.7	7.6	15

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 36000 Btuh, Power Input: 3200 Watts, E.E.R.: 11.3 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 1250 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	—	—	—	—	—	—	43450	3046
61	33804	28888	—	—	—	—	45420	3098
64	34884	24871	30590	—	—	—	46171	3149
67	36000	20881	26600	32319	38038	—	46922	3200
70	37152	16944	22663	28382	34101	35245	48001	3251
73	38304	—	18780	24499	30218	33702	48423	3302

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1000	1200	1250	1300	1400	1500
Total Capacity	.973	.994	1.00	1.006	1.017	1.028
Sensible Capacity	.948	.988	1.00	1.012	1.037	1.062
Heat of Rejection	.963	.989	1.00	1.011	1.033	1.054
Power Input	.978	.994	1.00	1.006	1.019	1.032

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

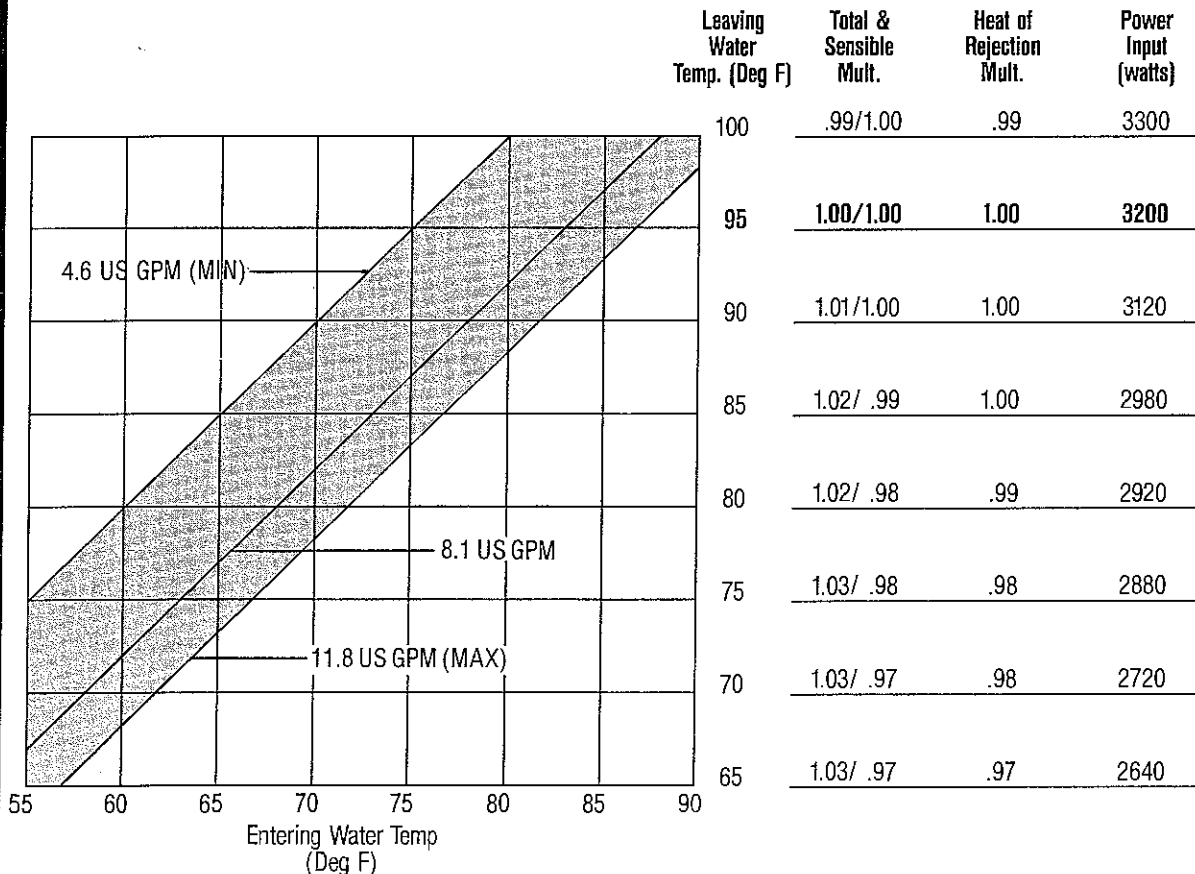

Heating Performance

Heating Capacity: 42500 Btuh, Power Input: 3200 Watts, C.O.P.: 3.9 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.046	1.033	1.015	1.00	.987	.976	.964
Heat of Absorption	1.075	1.051	1.020	1.00	.975	.956	.935
Power Input	.966	.978	.989	1.00	1.011	1.022	1.03

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1000	1200	1250	1300	1400	1500
Heating Capacity	.980	.994	1.00	1.006	1.017	1.028
Heat of Absorption	.969	.993	1.00	1.007	1.022	1.036
Power Input	.990	.998	1.00	1.002	1.005	1.008

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

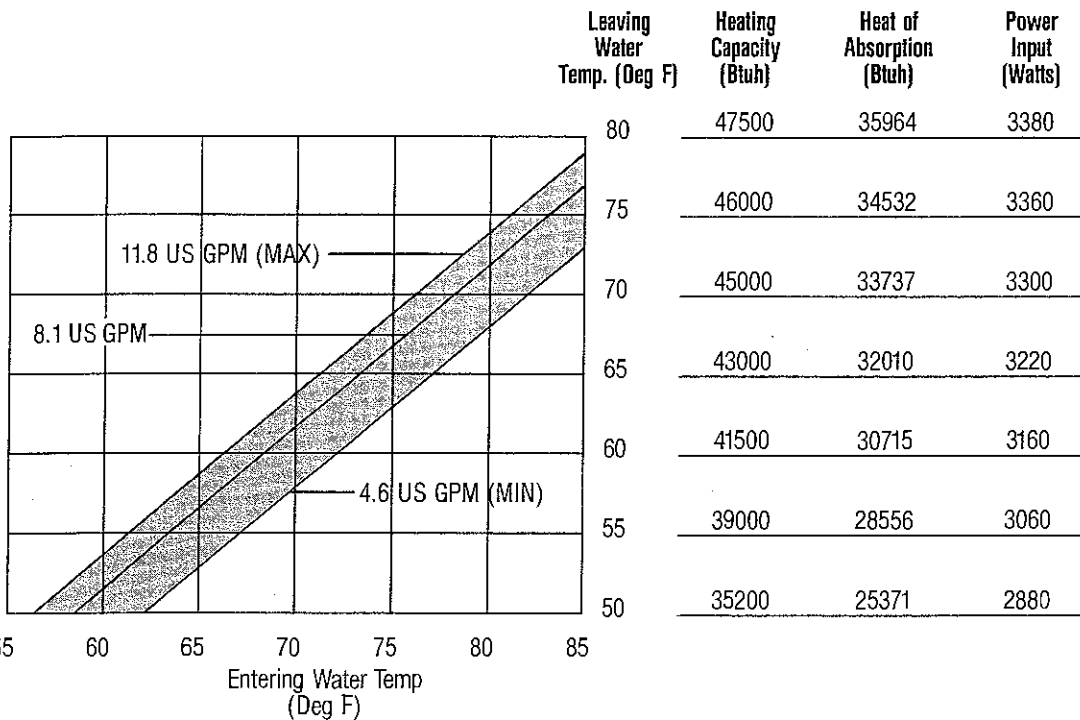


Water Pressure Drop:

A.R.I. Typical Application Flow Rates:

	3.1	1.5	2.2	2.7	3.2	3.9
Rate, (GPM/12 MBTU)	3.1	1.5	2.2	2.7	3.2	3.9
Water Flow, (US GPM)	9.4	4.6	6.6	8.1	9.6	11.8
Pressure Drop, (Ft.) (H ₂ O)	20.48	14.33	17.16	19.01	20.69	22.95
	(min.)		(Recommended)			(max.)

Wiring Diagram

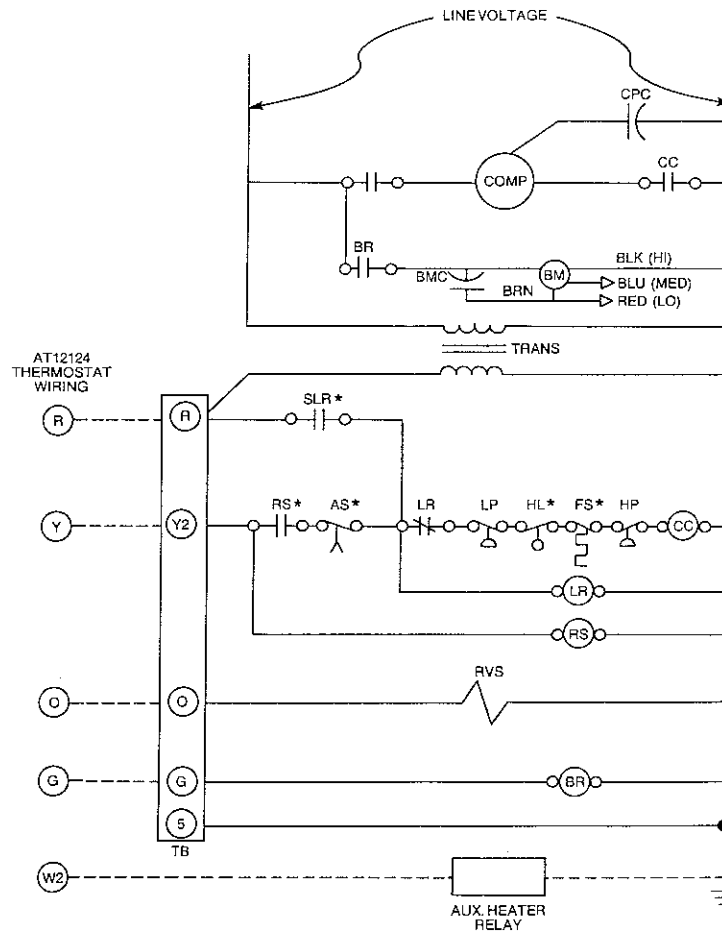

NOTES:
 --- Field Wiring
 Aux. Heater Relay is a field installed option.

ACO = AUTOMATIC CHANGEOVER RELAY
 AS = ANTI-SHORT CYCLE RELAY
 BM = BLOWER MOTOR
 BMC = BLOWER MOTOR CAPACITOR
 BR = BLOWER RELAY
 CC = COMPRESSOR CONTACTOR
 CCH = CRANKCASE HEATER
 COMP = COMPRESSOR
 CPC = COMPRESSOR CAPACITOR
 CR = CONTROL RELAY

DL = DEMAND LIMIT RELAY
 FS = FREEZE STAT
 HL = HIGH LEVEL CONDENSATE SWITCH
 HP = HIGH PRESSURE SWITCH
 HT = HIGH TEMPERATURE SWITCH
 LP = LOW PRESSURE SWITCH
 LR = LOCKOUT RELAY
 OL = OVERLOAD
 PR = PROGRAM RELAY
 RS = RANDOM START RELAY

RVR = REVERSING VALVE RELAY
 RVS = REVERSING VALVE SOLENOID
 SD = SHUTDOWN RELAY
 SLR = SPECIAL LOCKOUT RELAY
 SSM = SAFETY SHUTDOWN MODULE
 TB = 24-VOLT TERMINAL BLOCK
 TD = TIME DELAY RELAY
 TR = TIMER RELAY
 TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
 NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	1500	1420	1340	1250	1170	1080					1000
Lo	1360	1310	1250	1190	1110	1000					
Med	1290	1240	1190	1120	1030						

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

Continuing engineering research results in steady improvements. Therefore, these specifications are subject to change without notice.

© 1988 Climate Master Printed in U.S.A. 1/88


2007 Beechgrove Place
 Utica, New York 13501
 (315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

813 Series

Standard Operating Range
55°F to 95°F Entering Water Temp.


Size 042

Dimensions

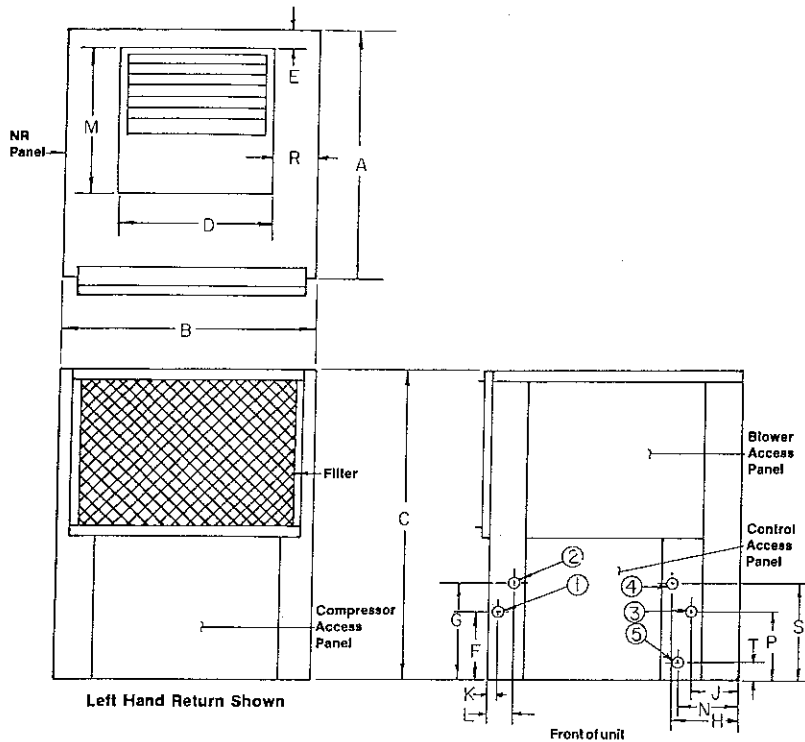

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T
IN.	25 ¹ / ₄	25 ¹ / ₄	42	12 ⁹ / ₁₆	1 ¹ / ₄	11	15	5 ³ / ₈	4 ¹ / ₄	1 ¹ / ₈	1 ¹ / ₈	13 ³ / ₁₆	5	9 ¹ / ₄	6	14 ¹ / ₂	2
CM.	64	64	107	32	5	28	38	14	11	3	4	35	13	23	15	37	5

FILTER SIZE	24" x 24" x 1"	SHIPPING WGT.	278 lbs.
	61 x 61 x 2.5 CM		126 Kg

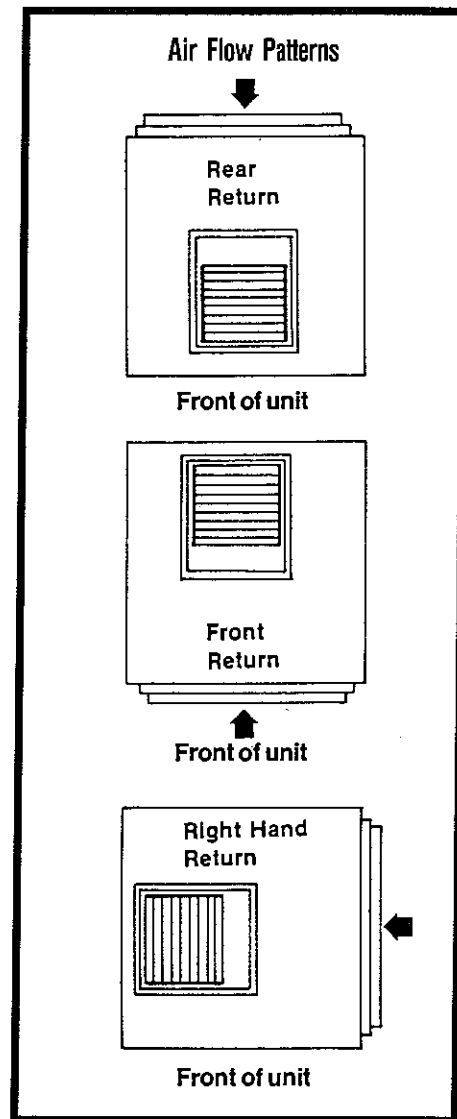

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	3.2	17.6	88.0	25.2	40
208/230	3	3.2	11.5	65.1	17.6	25
460	3	1.8	5.1	32.8	8.2	15

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 41500 Btuh, Power Input: 3520 Watts, E.E.R.: 11.8 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 1500 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	35856	—	—	—	—	—	47520	3355
61	37848	33666	—	—	—	—	49500	3411
64	39840	28985	35650	—	—	—	52711	3467
67	41500	24335	31000	37665	44330	—	53514	3520
70	42869	19747	26412	33077	39742	42625	54317	3573
73	44114	15190	21886	28551	35216	36735	55173	3629

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1260	1340	1450	1500	1700	1800
Total Capacity	.974	.985	.995	1.00	1.019	1.026
Sensible Capacity	.934	.967	.990	1.00	1.041	1.058
Heat of Rejection	.956	.971	.991	1.00	1.036	1.051
Power Input	.974	.983	.995	1.00	1.021	1.030

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

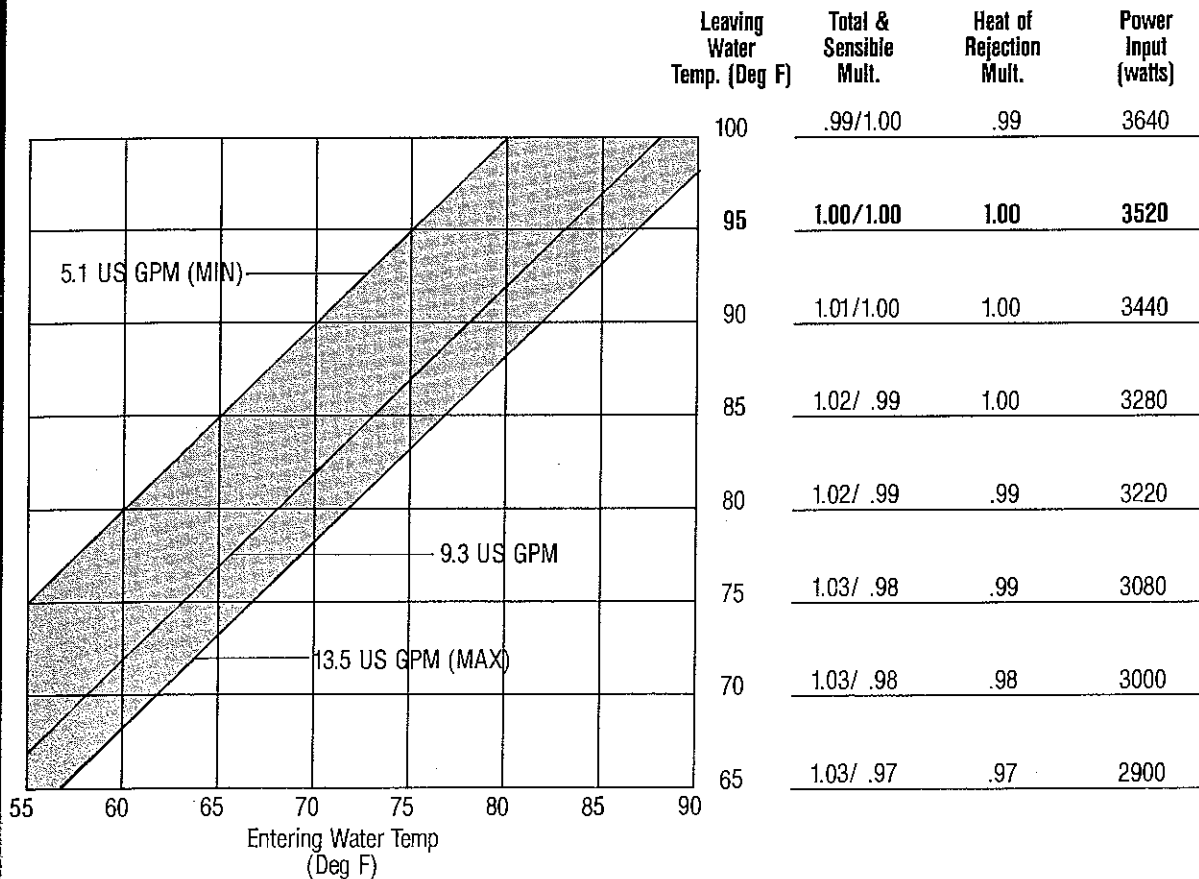

Heating Performance

Heating Capacity: 44500 Btuh, Power Input: 3340 Watts, C.O.P.: 3.9 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.063	1.040	1.025	1.00	.965	.919	.862
Heat of Absorption	1.107	1.076	1.045	1.00	.937	.864	.823
Power Input	.900	.930	.965	1.00	1.035	1.070	1.102

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1260	1340	1450	1500	1700	1800
Heating Capacity		.985	.995	1.00	1.019	1.026
Heat of Absorption		.980	.994	1.00	1.025	1.035
Power Input		.998	.999	1.00	1.003	1.004

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

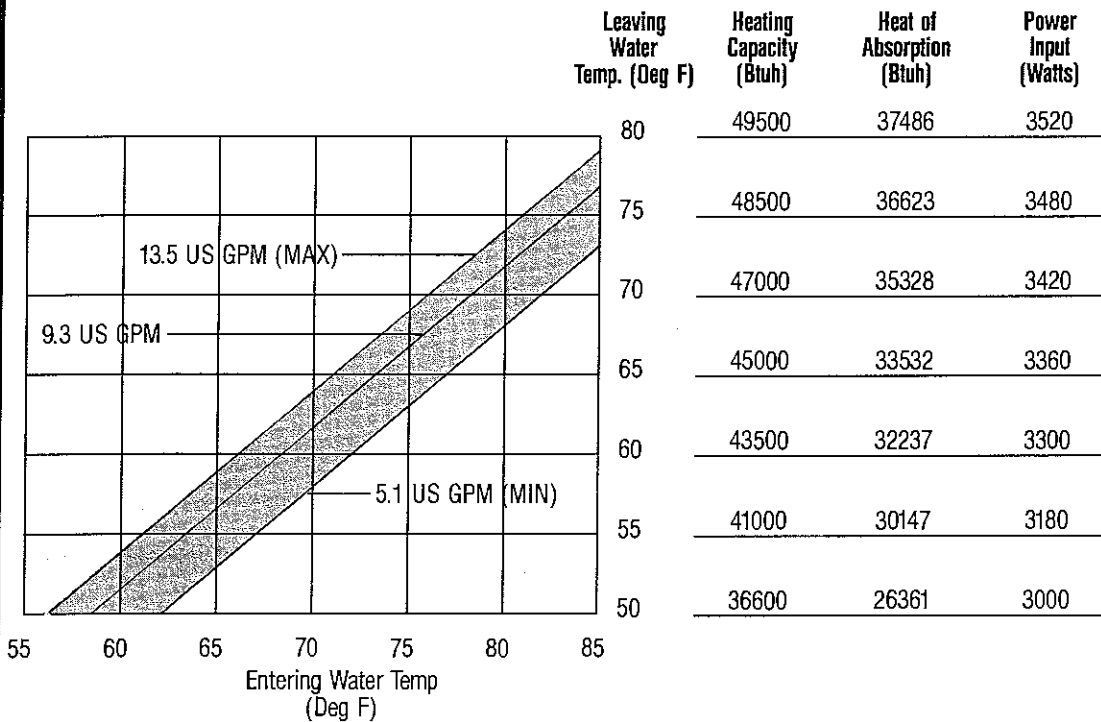


Water Pressure Drop:

A.R.I. Typical Application Flow Rates:

Rate, (GPM/12 MBTU)	3.1	1.5	2.2	2.7	3.5	3.9
Water Flow, (US GPM)	10.7	5.1	7.6	9.3	12.1	13.5
Pressure Drop, (Ft.) (H ₂ O)	22.30	5.88	12.92	20.78	30.14	33.89
		(min.)	(Recommended)			(max.)

Wiring Diagram

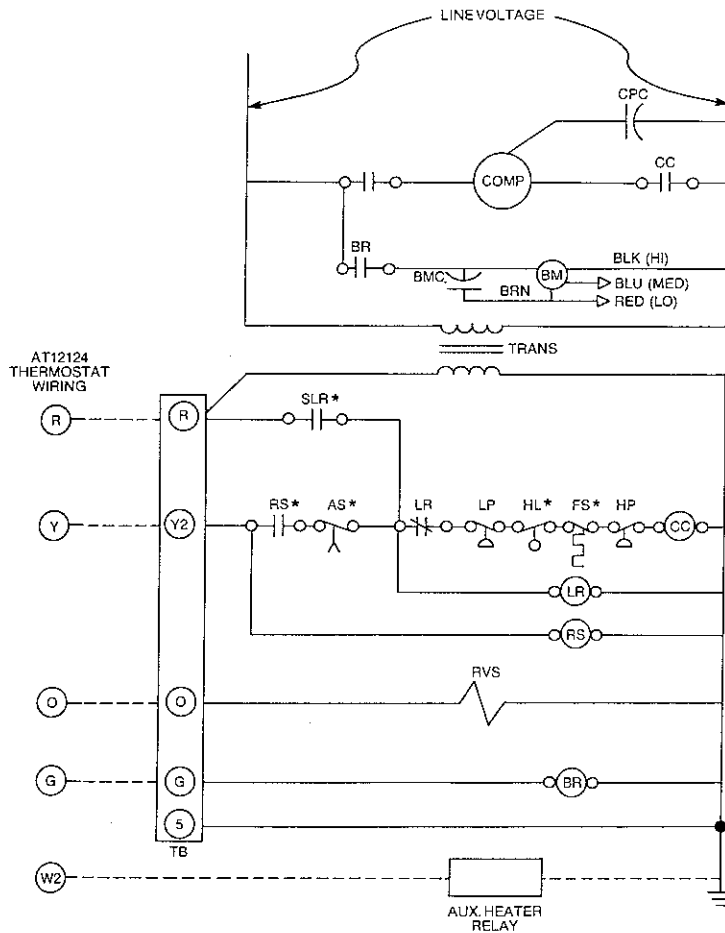

NOTES:
 --- Field Wiring
 Aux. Heater Relay is a field installed option.

- | | | |
|----------------------------------|-----------------------------------|---|
| ACC = AUTOMATIC CHANGEOVER RELAY | DL = DEMAND LIMIT RELAY | RVR = REVERSING VALVE RELAY |
| AS = ANTI-SHORT CYCLE RELAY | FS = FREEZESTAT | RVS = REVERSING VALVE SOLENOID |
| BM = BLOWER MOTOR | HL = HIGH LEVEL CONDENSATE SWITCH | SD = SHUTDOWN RELAY |
| BMC = BLOWER MOTOR CAPACITOR | HP = HIGH PRESSURE SWITCH | SLR = SPECIAL LOCKOUT RELAY |
| BR = BLOWER RELAY | HT = HIGH TEMPERATURE SWITCH | SSM = SAFETY SHUTDOWN MODULE |
| CC = COMPRESSOR CONTACTOR | LP = LOW PRESSURE SWITCH | TB = 24-VOLT TERMINAL BLOCK |
| CCH = CRANKCASE HEATER | LR = LOCKOUT RELAY | TD = TIME DELAY RELAY |
| COMP = COMPRESSOR | OL = OVERLOAD | TR = TIMER RELAY |
| CPC = COMPRESSOR CAPACITOR | PR = PROGRAM RELAY | TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER |
| CR = CONTROL RELAY | RS = RANDOM START RELAY | NOTE = * (DENOTES AVAILABLE AS OPTION) |

Blower Performance

Fan Speed	External Static Pressure (In wg)										Min. CFM
	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	
Hi	1780	1700	1620	1540	1440	1340					1260
Lo	1670	1610	1540	1460	1370	1260					
Med	1540	1500	1450	1400	1330						

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

813 Series


Standard Operating Range
55°F to 95°F Entering Water Temp.

Size 048


Dimensions

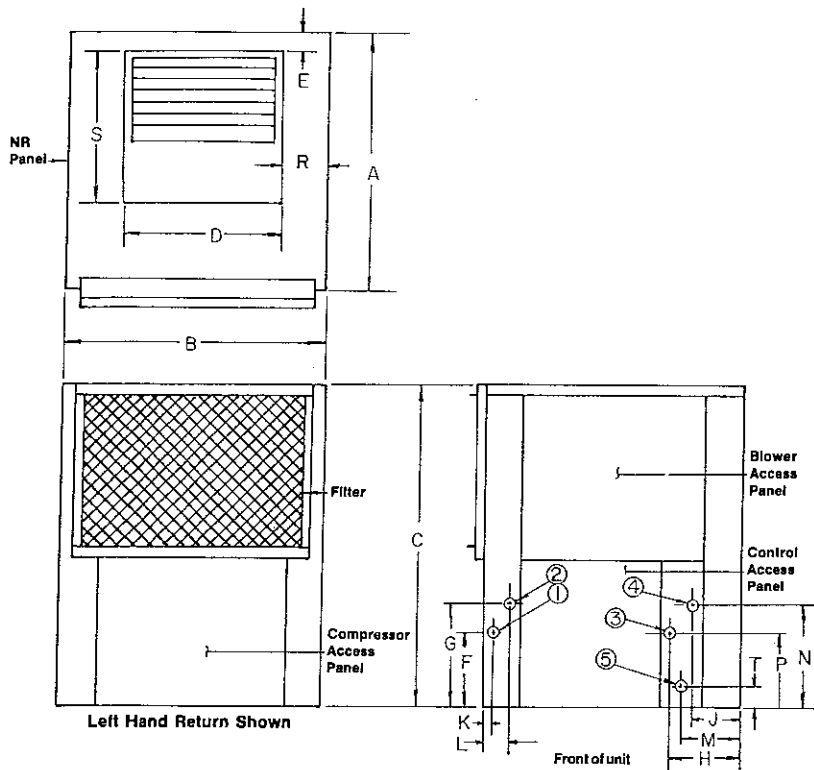


Air Flow Patterns

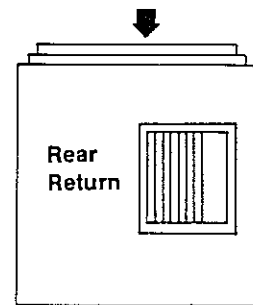

Front of unit



Front of unit



Front of unit

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T
IN.	28	28	43	15½	1½	11	15	5½	2½	1	1½	4¼	16⅞	9½	6¼	14¾	1⅞
CM.	71	71	109	39	4	28	38	14	6	2.5	4	11	42	24	16	37	4

FILTER SIZE	28" x 25" x 1"	SHIPPING WGT.	312 lbs.
	71 x 64 x 2.5 CM		142 Kg

Electrical Data		Blower	Compressor		Min Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	5.4	21.5	95.4	32.3	50
208/230	3	5.4	13.8	82.0	22.7	35
460	3	2.2	6.9	41.0	10.9	15

ClimateMaster

FORMERLY CHP CORP. AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 48500 Btuh, Power Input: 4300 Watts, E.E.R.: 11.3 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 1700 CFM & 95°F Leaving Water Temp)


Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	40788	—	—	—	—	—	53447	3892
61	43456	40834	—	—	—	—	56985	4029
64	46123	35156	43240	—	—	—	60523	4167
67	48500	29516	37600	45684	—	—	63176	4300
70	50585	23951	32035	40119	48203	49444	66019	4433
73	52429	18424	26546	34629	42714	43390	67977	4571

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1400	1675	1700	1850	2050	2130
Total Capacity	.974	.998	1.00	1.012	1.029	1.035
Sensible Capacity	.940	.995	1.00	1.027	1.064	1.078
Heat of Rejection	.952	.996	1.00	1.024	1.056	1.069
Power Input	.976	.998	1.00	1.014	1.033	1.040

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

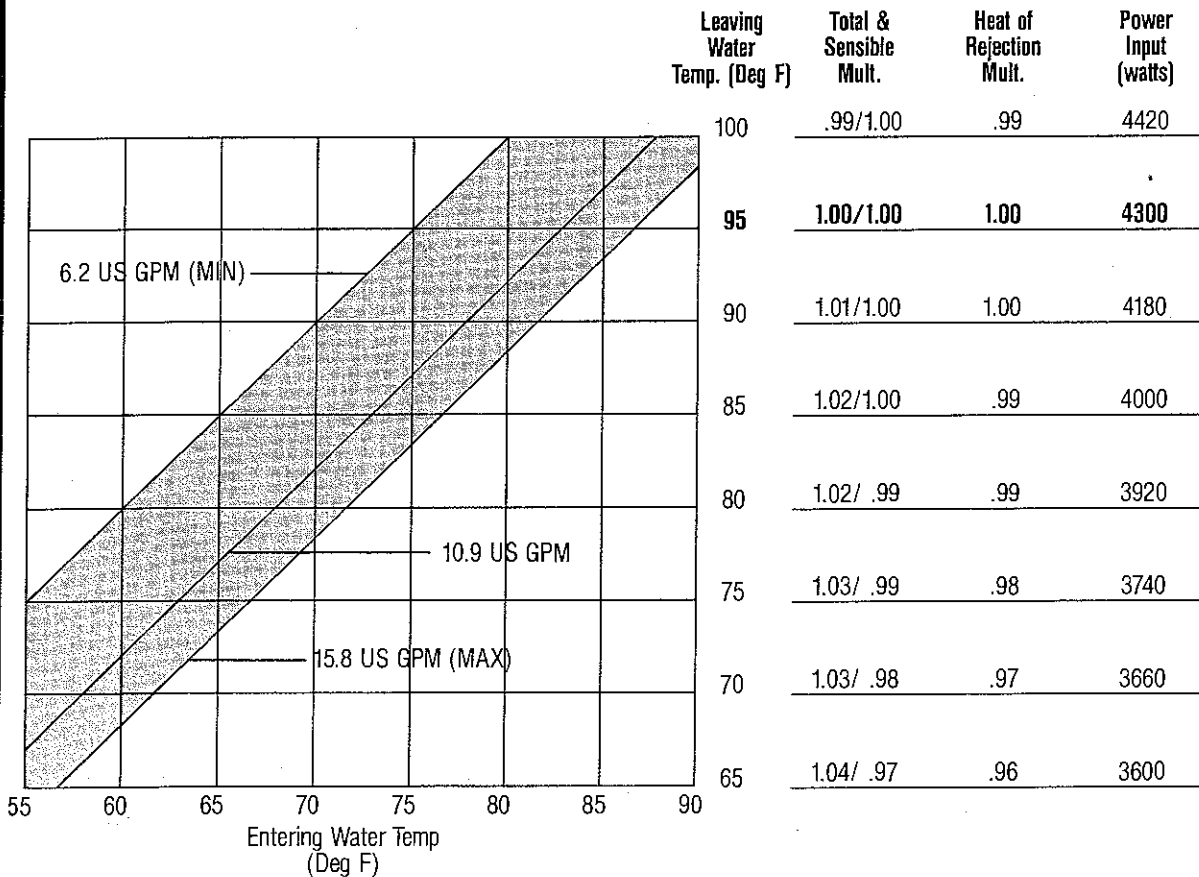

Heating Performance

Heating Capacity: 59000 Btuh, Power Input: 4560 Watts, C.O.P.: 3.8 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.01	1.007	1.004	1.00	.995	.989	.974
Heat of Absorption	1.035	1.024	1.013	1.00	.978	.967	.951
Power Input	.936	.953	.977	1.00	1.023	1.047	1.073

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1400	1675	1700	1850	2050	2130
Heating Capacity	.976	.998	1.00	1.012	1.029	1.035
Heat of Absorption	.976	.998	1.00	1.015	1.035	1.043
Power Input	.988	.999	1.00	1.006	1.014	1.018

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

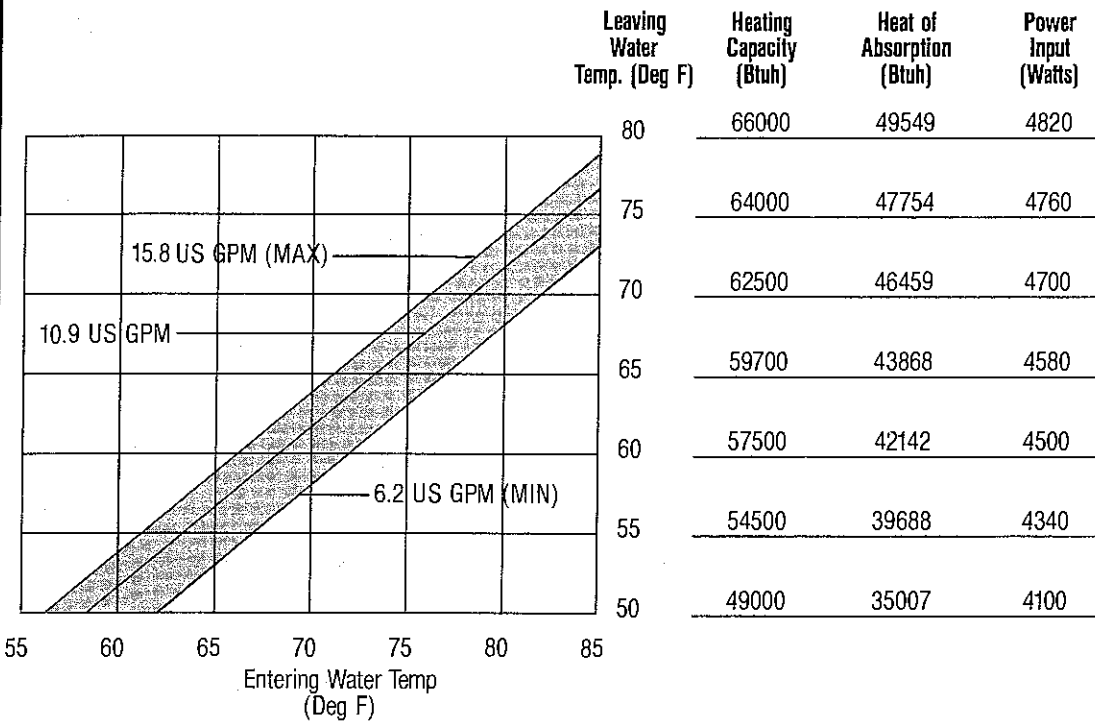

Water Pressure Drop:

A.R.I. Typical Application Flow Rates:


	3.1	1.5	2.2	2.7	3.5	3.9
Rate, (GPM/12 MBTU)						
Water Flow, (US GPM)	12.6	6.2	8.9	10.9	14.14	15.8
Pressure Drop, (Ft.) (H ₂ O)	18.20	5.08	8.67	13.02	21.9	27.35

(min.)

(Recommended)

(max.)

Wiring Diagram

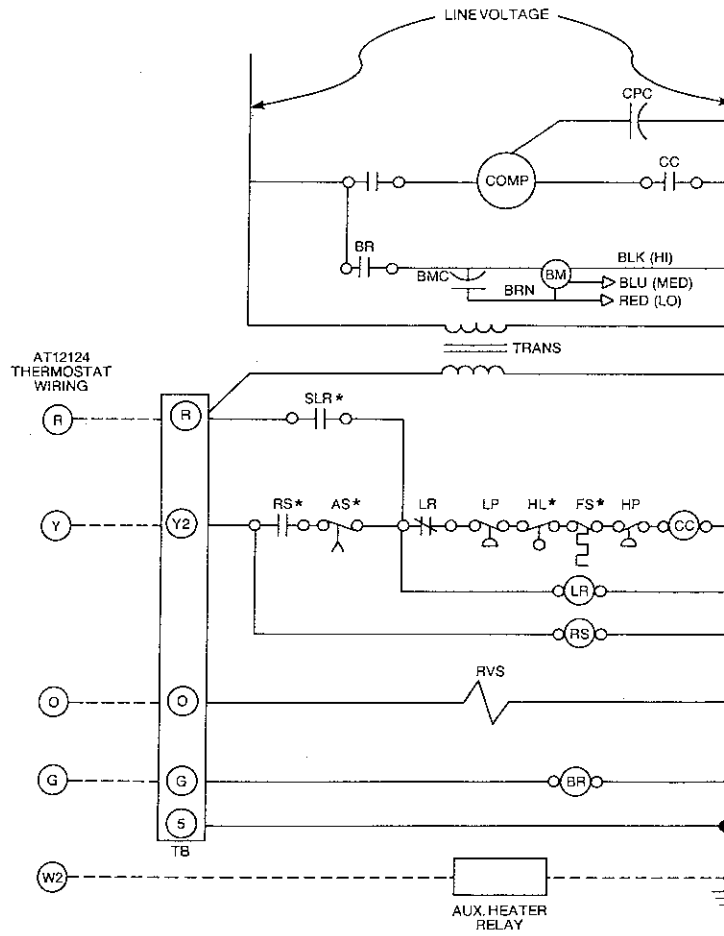

NOTES:
 ---- Field Wiring
 Aux. Heater Relay is a field installed option.

- ACO = AUTOMATIC CHANGEDOVER RELAY
- AS = ANTI-SHORT CYCLE RELAY
- BM = BLOWER MOTOR
- BMC = BLOWER MOTOR CAPACITOR
- BR = BLOWER RELAY
- CC = COMPRESSOR CONTACTOR
- CCH = CRANKCASE HEATER
- CDMP = COMPRESSOR
- CPC = COMPRESSOR CAPACITOR
- CR = CONTROL RELAY

- DL = DEMAND LIMIT RELAY
- FS = FREEZESTAT
- HL = HIGH LEVEL CONDENSATE SWITCH
- HP = HIGH PRESSURE SWITCH
- HT = HIGH TEMPERATURE SWITCH
- LP = LOW PRESSURE SWITCH
- LR = LOCKOUT RELAY
- OL = OVERLOAD
- PR = PROGRAM RELAY
- RS = RANDOM START RELAY

- RVR = REVERSING VALVE RELAY
- RVS = REVERSING VALVE SOLENOID
- SD = SHUTDOWN RELAY
- SLR = SPECIAL LOCKOUT RELAY
- SSM = SAFETY SHUTDOWN MODULE
- TB = 24-VOLT TERMINAL BLOCK
- TD = TIME DELAY RELAY
- TR = TIMER RELAY
- TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER
- NOTE = * (DENOTES AVAILABLE AS OPTION)

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	2130	2050	1960	1860	1750	1630					1400
Lo	1980	1900	1810	1720	1620	1520					
Med	1810	1730	1650	1570	1490	1400					

Blower Performance is based on wet coil and clean filter

ClimateMaster

FORMERLY CHP CORP. AND FORMERLY
 FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
 Utica, New York 13501


(315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973

813 Series


Standard Operating Range
55°F to 95°F Entering Water Temp.

Size 060


Dimensions

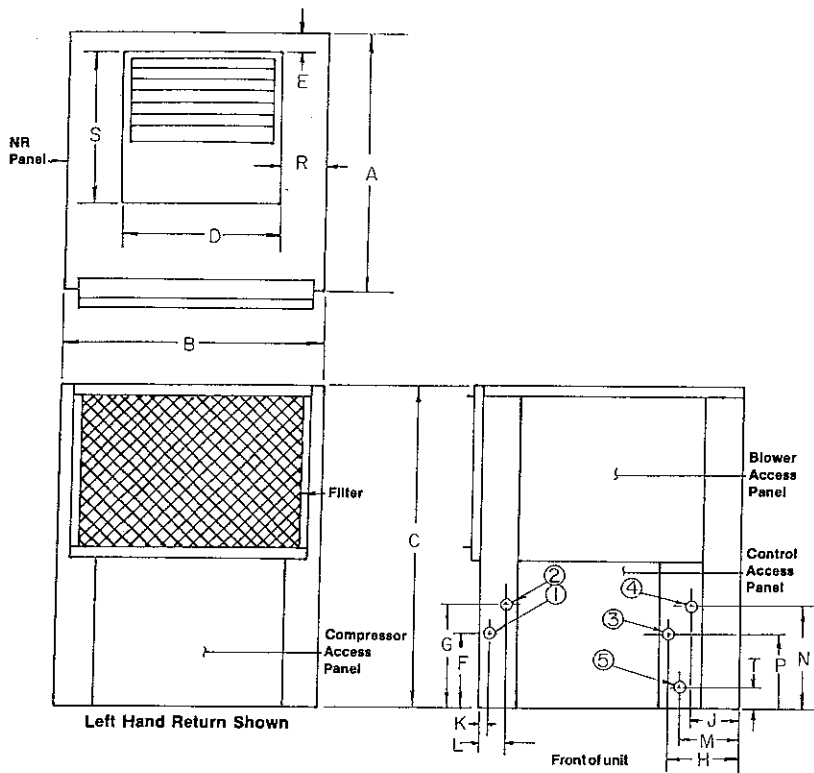


Air Flow Patterns

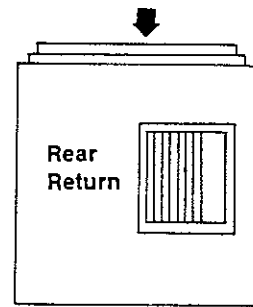

Front of unit



Front of unit

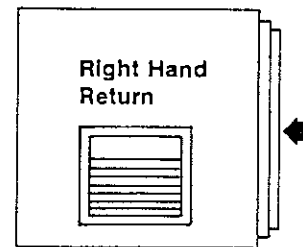

Front of unit

SZ.	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T
IN.	28	28	43	15½	1½	11	15	5	3¾	1	1½	5⅞	14⅞	9½	6¼	14¼	1⅞
CM.	71	71	109	39	4	28	38	13	9	2.5	4	13	38	24	16	37	4

FILTER SIZE	28" x 25" x 1" 71 x 64 x 2.5 CM	SHIPPING WGT.	339 lbs. 154 Kg
-------------	------------------------------------	---------------	--------------------

Electrical Data		Blower	Compressor		Min. Ckt. Ampacity	Max. Fuse or HACR Size
Voltage	Phase	FLA	RLA	LRA		
208/230	1	5.8	27.6	125.0	40.3	60
208/230	3	5.8	16.1	90.0	26.0	40
480	3	2.6	7.7	45.0	12.3	20

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY
FRIEDRICH™ CLIMATE MASTER, INC.

2007 Beechgrove Place
Utica, New York 13501
(315) 724-7111

Cooling Performance

Total Cooling Capacity: 63000 Btuh, Power Input: 5500 Watts, E.E.R.: 11.5 (at A.R.I. Standard 320-86 Rating Conditions)

Effect of Variation in Entering Air Temperature:

(Based upon 2000 CFM & 95°F Leaving Water Temp)

Entering AIR (Deg F) Wet Bulb	Total Capacity (Btuh)	Sensible Capacity (Btuh) @ Entering Air (Deg F) Dry Bulb:					Heat of Rejection (Btuh)	Power Input (watts)
		75	80	85	90	95		
58	55125	—	—	—	—	—	71550	—
61	56448	51585	—	—	—	—	74004	5264
64	59913	44413	54625	—	—	—	78010	5385
67	63000	37288	47500	57712	—	—	81772	5500
70	65709	30258	40470	50683	57095	—	84961	5615
73	68103	—	33535	33535	53960	62462	87987	5737


Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1700	1900	1950	2000	2080	2140
Total Capacity	.977	.993	.997	1.00	1.006	1.010
Sensible Capacity	.957	.985	.992	1.00	1.012	1.022
Heat of Rejection	.958	.986	.993	1.00	1.011	1.019
Power Input	.976	.992	.996	1.00	1.006	1.011

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Cooling Capacity Correction for Other Leaving Water Temperatures:

Leaving Water Temp. (Deg F)	Total & Sensible Mult.	Heat of Rejection Mult.	Power Input (watts)
100	.98/1.00	.99	5650
95	1.00/1.00	1.00	5500
90	1.00/1.00	.99	5350
85	1.02/1.00	.99	5100
80	1.02/ .99	.99	4980
75	1.03/ .98	.99	4760
70	1.03/ .98	.99	4660
65	1.03/ .98	.98	4550

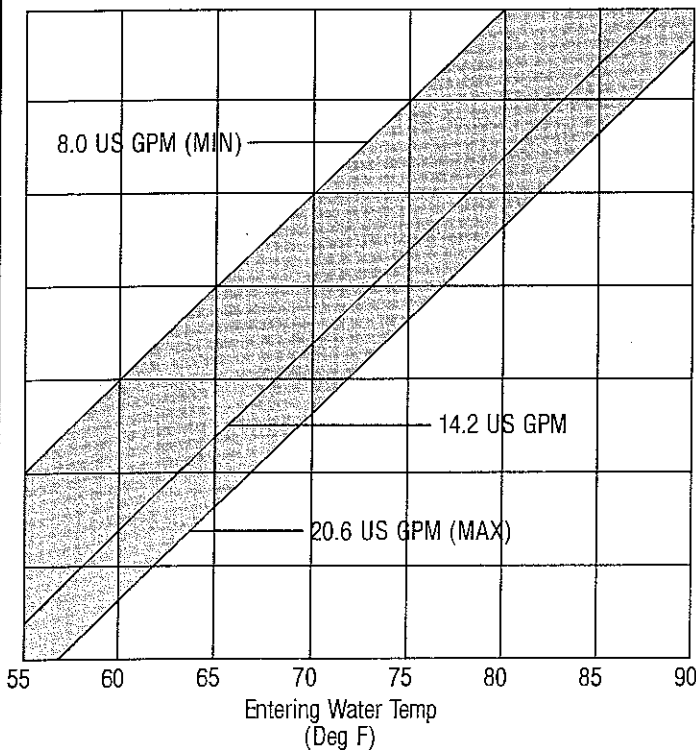

Heating Performance

Heating Capacity: 78000 Btuh, Power Input: 5850 Watts, C.O.P.: 3.9 (at A.R.I. Standard 320-86 Rating Conditions)

Multiplier for Effect of Variation in Entering Air Temperature:


Entering Air Temp. Deg. F.	55	60	65	70	75	80	85
Heating Capacity	1.026	1.013	1.007	1.00	.994	.987	.976
Heat of Absorption	1.051	1.034	1.017	1.00	.982	.965	.941
Power Input	.940	.951	.975	1.00	1.025	1.049	1.073

Multiplier for Effect of Variation in Air Flow:

Air Flow Rate, CFM	1700	1900	1950	2000	2080	2140
Heating Capacity	.977	.993	.997	1.00	1.006	1.010
Heat of Absorption	.971	.991	.996	1.00	1.007	1.012
Power Input	.994	.998	.999	1.00	1.002	1.004

Figures in Bold Face Type are @ A.R.I. Rating Conditions.

Heating Capacity Correction for Other Leaving Water Temperatures:

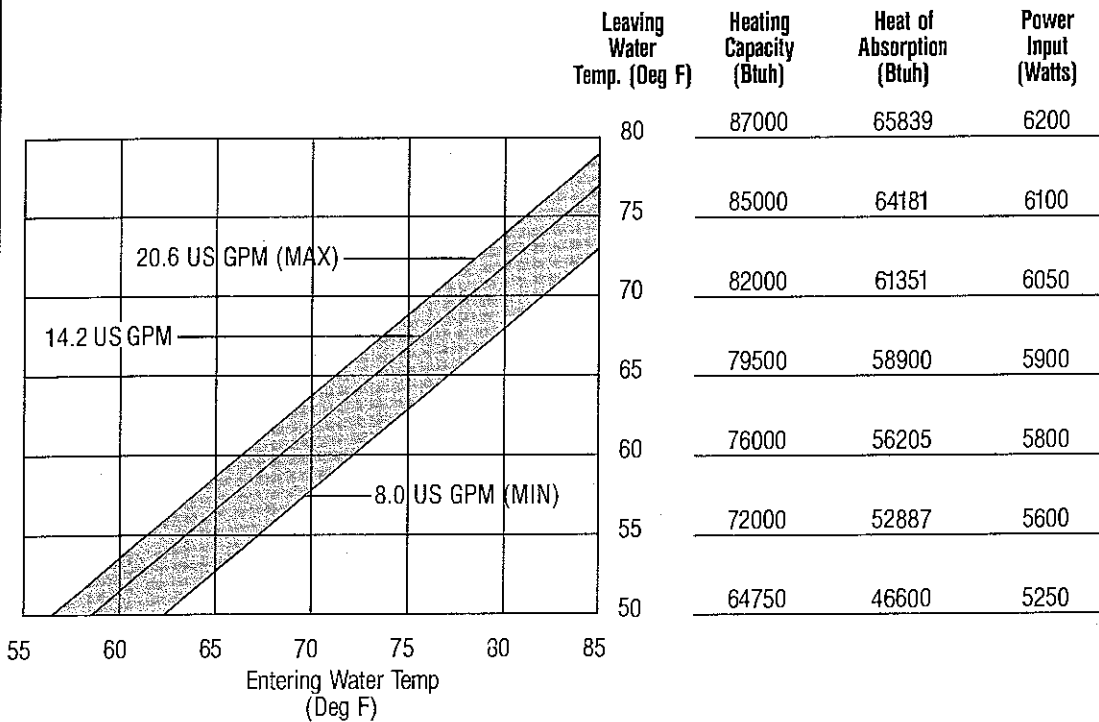


Water Pressure Drop:

A.R.I. Typical Application Flow Rates:

Rate, (GPM/12 MBTU)	3.1	1.5	2.2	2.7	3.5	3.9
Water Flow, (US GPM)	16.4	8.0	11.5	14.2	18.4	20.6
Pressure Drop, (Ft.) (H ₂ O)	12.77	3.51	5.99	9.15	15.35	19.25
	(min.)		(Recommended)			(max.)

Wiring Diagram

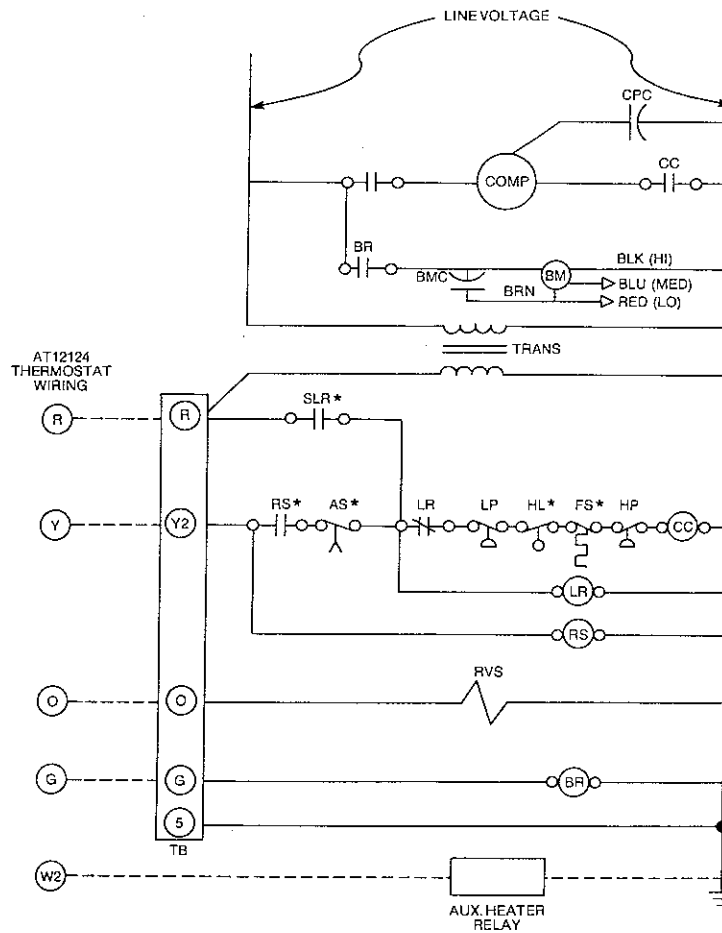

NOTES:
 --- Field Wiring
 Aux. Heater Relay is a field installed option.

- | | | |
|----------------------------------|-----------------------------------|---|
| ACO = AUTOMATIC CHANGEOVER RELAY | DL = DEMAND LIMIT RELAY | RVR = REVERSING VALVE RELAY |
| AS = ANTI-SHORT CYCLE RELAY | FS = FREEZESTAT | RVS = REVERSING VALVE SOLENOID |
| BM = BLOWER MOTOR | HL = HIGH LEVEL CONDENSATE SWITCH | SD = SHUTDOWN RELAY |
| BMC = BLOWER MOTOR CAPACITOR | HP = HIGH PRESSURE SWITCH | SLR = SPECIAL LOCKOUT RELAY |
| BR = BLOWER RELAY | HT = HIGH TEMPERATURE SWITCH | SSM = SAFETY SHUTDOWN MODULE |
| CC = COMPRESSOR CONTACTOR | LP = LOW PRESSURE SWITCH | TB = 24-VOLT TERMINAL BLOCK |
| CCH = CRANKCASE HEATER | LR = LOCKOUT RELAY | TD = TIME DELAY RELAY |
| COMP = COMPRESSOR | OL = OVERLOAD | TR = TIMER RELAY |
| CPC = COMPRESSOR CAPACITOR | PR = PROGRAM RELAY | TRANS = LINE VOLTAGE TO 24-VOLT TRANSFORMER |
| CR = CONTROL RELAY | RS = RANDOM START RELAY | NOTE = * (DENOTES AVAILABLE AS OPTION) |

Blower Performance

External Static Pressure (In wg)

Fan Speed	.1	.2	.3	.4	.5	.6	.7	.8	.9	1.0	Min. CFM
Hi	2200	2140	2080	2010	1940	1860					1700
Lo	2110	2050	2000	1940	1870	1800					
Med	2060	2000	1940	1880	1820	1760	1700				

Blower Performance is based on wet coil and clean filter

ClimateMaster®

FORMERLY CHP CORP. AND FORMERLY FRIEDRICH™ CLIMATE MASTER, INC.

Continuing engineering research results in steady improvements. Therefore, these specifications are subject to change without notice.

©1988 Climate Master Printed in U.S.A. 1/88

2007 Beechgrove Place
 Utica, New York 13501
 (315) 724-7111 FAX: (315) 724-6945; TWX: 510-600-7973